



European Network of
Transmission System Operators
for Electricity

CONTINGENCY PROFILE SPECIFICATION

2021-04-21

SOC APPROVED
VERSION 1.0

1 Copyright notice:

2 **Copyright © ENTSO-E. All Rights Reserved.**

3 This document and its whole translations may be copied and furnished to others, and derivative
4 works that comment on or otherwise explain it or assist in its implementation may be prepared,
5 copied, published and distributed, in whole or in part, without restriction of any kind, provided
6 that the above copyright notice and this paragraph are included on all such copies and
7 derivative works. However, this document itself may not be modified in any way, except for
8 literal and whole translation into languages other than English and under all circumstances, the
9 copyright notice or references to ENTSO-E may not be removed.

10 This document and the information contained herein is provided on an "as is" basis.

11 **ENTSO-E DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT**
12 **LIMITED TO ANY WARRANTY THAT THE USE OF THE INFORMATION HEREIN WILL NOT**
13 **INFRINGE ANY RIGHTS OR ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR**
14 **FITNESS FOR A PARTICULAR PURPOSE.**

15 **This document is maintained by the ENTSO-E CIM EG. Comments or remarks are to be**
16 **provided at cim@entsoe.eu**

17 **NOTE CONCERNING WORDING USED IN THIS DOCUMENT**

18 The force of the following words is modified by the requirement level of the document in which
19 they are used.

- 20 • **SHALL:** This word, or the terms "REQUIRED" or "MUST", means that the definition is an
21 absolute requirement of the specification.
- 22 • **SHALL NOT:** This phrase, or the phrase "MUST NOT", means that the definition is an
23 absolute prohibition of the specification.
- 24 • **SHOULD:** This word, or the adjective "RECOMMENDED", means that there may exist valid
25 reasons in particular circumstances to ignore a particular item, but the full implications must
26 be understood and carefully weighed before choosing a different course.
- 27 • **SHOULD NOT:** This phrase, or the phrase "NOT RECOMMENDED", means that there may
28 exist valid reasons in particular circumstances when the particular behaviour is acceptable
29 or even useful, but the full implications should be understood and the case carefully weighed
30 before implementing any behaviour described with this label.
- 31 • **MAY:** This word, or the adjective "OPTIONAL", means that an item is truly optional.

32

33

Revision History

Version	Release	Date	Paragraph	Comments
1	0	2021-04-21		Approved by SOC.

34	CONTENTS		
35	Copyright notice:		2
36	Revision History		3
37	CONTENTS		4
38	1	Introduction	6
39	2	Application profile specification	6
40	2.1	Version information	6
41	2.2	Constraints naming convention	6
42	2.3	Profile constraints	7
43	2.4	Metadata	9
44	2.4.1	Constraints	10
45	2.4.2	Reference metadata	10
46	3	Detailed Profile Specification	10
47	3.1	General	10
48	3.2	(md) FullModel	12
49	3.3	(md) Model root class	13
50	3.4	(abstract,CSA) Region root class	16
51	3.5	(abstract,CSA) SystemOperator root class	16
52	3.6	(abstract,CSA) AssessedElement	16
53	3.7	(abstract) Contingency	17
54	3.8	(abstract) ContingencyElement	17
55	3.9	ContingencyEquipment	18
56	3.10	(abstract) Equipment root class	18
57	3.11	(CSA) ExceptionalContingency	18
58	3.12	(abstract) IdentifiedObject root class	19
59	3.13	(CSA) OrdinaryContingency	19
60	3.14	(CSA) OutOfRangeContingency	20
61	3.15	(abstract,CSA) RemedialAction	20
62	3.16	UnitMultiplier enumeration	21
63	3.17	UnitSymbol enumeration	22
64	3.18	ContingencyEquipmentStatusKind enumeration	27
65	3.19	PerCent datatype	27
66	3.20	Boolean primitive	27
67	3.21	Date primitive	27
68	3.22	DateTime primitive	28
69	3.23	(eumd) DateTimeStamp primitive	28
70	3.24	Duration primitive	28
71	3.25	Float primitive	28
72	3.26	String primitive	28
73	3.27	(profcim) IRI primitive	28
74	3.28	(profcim) StringFixedLanguage primitive	28
75	3.29	(profcim) StringIRI primitive	28
76	3.30	(profcim) URL primitive	29
77	Annex A (informative): Sample data		30

78	A.1	General.....	30
79	A.2	Header.....	30
80	A.3	Contingency.....	31
81			
82		List of figures	
83		Figure 1 – Class diagram ContingencyProfile::ContingencyProfile	10
84		Figure 2 – Class diagram ContingencyProfile::HeaderContingencyProfile	11
85		Figure 3 – Class diagram ContingencyProfile::ContingencyDatatypes	12
86			
87		List of tables	
88		Table 1 – Attributes of ContingencyProfile::FullModel	12
89		Table 2 – Attributes of ContingencyProfile::Model	13
90		Table 3 – Attributes of ContingencyProfile::AssessedElement.....	16
91		Table 4 – Attributes of ContingencyProfile::Contingency	17
92		Table 5 – Association ends of ContingencyProfile::Contingency with other classes	17
93		Table 6 – Attributes of ContingencyProfile::ContingencyElement	17
94		Table 7 – Association ends of ContingencyProfile::ContingencyElement with other	
95		classes	18
96		Table 8 – Attributes of ContingencyProfile::ContingencyEquipment.....	18
97		Table 9 – Association ends of ContingencyProfile::ContingencyEquipment with other	
98		classes	18
99		Table 10 – Attributes of ContingencyProfile::ExceptionalContingency	18
100		Table 11 – Association ends of ContingencyProfile::ExceptionalContingency with other	
101		classes	19
102		Table 12 – Attributes of ContingencyProfile::IdentifiedObject	19
103		Table 13 – Attributes of ContingencyProfile::OrdinaryContingency	19
104		Table 14 – Association ends of ContingencyProfile::OrdinaryContingency with other	
105		classes	20
106		Table 15 – Attributes of ContingencyProfile::OutOfRangeContingency	20
107		Table 16 – Association ends of ContingencyProfile::OutOfRangeContingency with	
108		other classes	20
109		Table 17 – Attributes of ContingencyProfile::RemedialAction	20
110		Table 18 – Literals of ContingencyProfile::UnitMultiplier	21
111		Table 19 – Literals of ContingencyProfile::UnitSymbol	22
112		Table 20 – Literals of ContingencyProfile::ContingencyEquipmentStatusKind	27
113		Table 21 – Attributes of ContingencyProfile::PerCent.....	27
114			

115 1 Introduction

116 The contingency profile is a profile to exchange a list of contingencies.

117 A contingency is the identified and possible or already occurred fault of an element, including
118 not only the transmission system elements, but also significant grid users and distribution
119 network elements if relevant for the transmission system operational security.¹

120 The contingencies are input data for security analysis.

121 Preventive remedial actions may be applied in the base case and consequently in each
122 contingency case since each contingency is applied on top of the base case with the
123 consideration of all applied preventive remedial actions. There is not explicit association
124 between preventive remedial actions and contingencies because of the definition of preventive
125 remedial action. Curative remedial actions may be applied to the contingencies they are
126 associated with and these association are the ones that is included in this profile. It is required
127 to have an explicit list of assessed elements that relate to a given contingency. Only these
128 assessed elements will be scanned when the contingency is simulated. Therefore, the profile
129 restricts that at least one assessed element shall be scanned for a given contingency. The
130 profile allows that contingencies can be associated to a given region, which indicates in which
131 region these contingencies are studied. For instance, in CSA process normally the region has
132 the meaning of a capacity calculation region.

133 2 Application profile specification

134 2.1 Version information

135 The content is generated from UML model file CGMES30v25_501-20v01_HeaderMetaData-
136 10v08_CSA01v35.eap.

137 This edition is based on the IEC 61970 UML version 'IEC61970CIM17v40', dated '2020-08-24'.

- 138 - Title: Contingency Vocabulary
- 139 - Keyword: CO
- 140 - Description: This vocabulary is describing the contingency profile.
- 141 - Version IRI: <http://entsoe.eu/ns/CIM/Contingency-EU/1.0>
- 142 - Version info: 1.0.0
- 143 - Prior version:
- 144 - Conforms to: urn:iso:std:iec:61970-600-2:ed-1|urn:iso:std:iec:61970-301:ed-
145 7:amd1|file:///iec61970cim17v40_iec61968cim13v13a_iec62325cim03v17a.eap|urn:iso:
146 std:iec:61970-401:draft:ed-1|urn:iso:std:iec:61970-501:draft:ed-2|file:///CGMES-
147 30v25_501-20v01.eap
- 148 - Identifier: urn:uuid:dad2b824-0e34-48c4-93b1-b6f64801b41a

149

150 2.2 Constraints naming convention

151 The naming of the rules shall not be used for machine processing. The rule names are just a
152 string. The naming convention of the constraints is as follows.

153 "{rule.Type}:{rule.Standard}:{rule.Profile}:{rule.Property}:{rule.Name}"

154 where

¹ [SOURCE: CACM art.2.10]

- 155 rule.Type: C – for constraint; R – for requirement
- 156 rule.Standard: the number of the standard e.g. 301 for 61970-301, 456 for 61970-456, 13 for
157 61968-13. 61970-600 specific constraints refer to 600 although they are related to one or
158 combination of the 61970-450 series profiles. For CSA profiles, CSA is used.
- 159 rule.Profile: the abbreviation of the profile, e.g. TP for Topology profile. If set to “ALL” the
160 constraint is applicable to all IEC 61970-600 profiles.
- 161 rule.Property: for UML classes, the name of the class, for attributes and associations, the name
162 of the class and attribute or association end, e.g. EnergyConsumer, IdentifiedObject.name, etc.
163 If set to “NA” the property is not applicable to a specific UML element.
- 164 rule.Name: the name of the rule. It is unique for the same property.
- 165 Example: C:600:ALL:IdentifiedObject.name:stringLength

166

167

168 2.3 Profile constraints

169 This clause defines requirements and constraints that shall be fulfilled by applications that
170 conform to this document.

171 This document is the master for rules and constraints tagged "CSA". For the sake of self-
172 containment, the list below also includes a copy of the relevant rules from IEC 61970-452,
173 tagged "452".

- 174 • C:452:ALL:NA:datatypes

175 According to 61970-501, datatypes are not exchanged in the instance data. The
176 UnitMultiplier is 1 in cases none value is specified in the profile.

- 177 • R:452:ALL:NA:exchange

178 Optional and required attributes and associations must be imported and exported if they
179 are in the model file prior to import.

- 180 • R:452:ALL:NA:exchange1

181 If an optional attribute does not exist in the imported file, it does not have to be exported
182 in case exactly the same data set is exported, i.e. the tool is not obliged to automatically
183 provide this attribute. If the export is resulting from an action by the user performed after
184 the import, e.g. data processing or model update the export can contain optional
185 attributes.

- 186 • R:452:ALL:NA:exchange2

187 In most of the profiles the selection of optional and required attributes is made so as to
188 ensure a minimum set of required attributes without which the exchange does not fulfil
189 its basic purpose. Business processes governing different exchanges can require
190 mandatory exchange of certain optional attributes or associations. Optional and required
191 attributes and associations shall therefore be supported by applications which claim
192 conformance with certain functionalities of the IEC 61970-452. This provides flexibility
193 for the business processes to adapt to different business requirements and base the
194 exchanges on IEC 61970-452 compliant applications.

- 195 • R:452:ALL:NA:exchange3

- 196 An exporter may, at his or her discretion, produce a serialization containing additional
197 class data described by the CIM Schema but not required by this document provided
198 these data adhere to the conventions established in Clause 5.
- 199 • R:452:ALL:NA:exchange4
- 200 From the standpoint of the model import used by a data recipient, the document
201 describes a subset of the CIM that importing software shall be able to interpret in order
202 to import exported models. Data providers are free to exceed the minimum requirements
203 described herein as long as their resulting data files are compliant with the CIM Schema
204 and the conventions established in Clause 5. The document, therefore, describes
205 additional classes and class data that, although not required, exporters will, in all
206 likelihood, choose to include in their data files. The additional classes and data are
207 labelled as required (cardinality 1..1) or as optional (cardinality 0..1) to distinguish them
208 from their required counterparts. Please note, however, that data importers could
209 potentially receive data containing instances of any and all classes described by the
210 CIM Schema.
- 211 • R:452:ALL:NA:cardinality
- 212 The cardinality defined in the CIM model shall be followed, unless a more restrictive
213 cardinality is explicitly defined in this document. For instance, the cardinality on the
214 association between VoltageLevel and BaseVoltage indicates that a VoltageLevel shall
215 be associated with one and only one BaseVoltage, but a BaseVoltage can be associated
216 with zero to many VoltageLevels.
- 217 • R:452:ALL:NA:associations
- 218 Associations between classes referenced in this document and classes not referenced
219 here are not required regardless of cardinality.
- 220 • R:452:ALL:IdentifiedObject.name:rule
- 221 The attribute “name” inherited by many classes from the abstract class IdentifiedObject
222 is not required to be unique. It must be a human readable identifier without additional
223 embedded information that would need to be parsed. The attribute is used for purposes
224 such as User Interface and data exchange debugging. The MRID defined in the data
225 exchange format is the only unique and persistent identifier used for this data exchange.
226 The attribute IdentifiedObject.name is, however, always required for CoreEquipment
227 profile and Short Circuit profile.
- 228 • R:452:ALL:IdentifiedObject.description:rule
- 229 The attribute “description” inherited by many classes from the abstract class
230 IdentifiedObject must contain human readable text without additional embedded
231 information that would need to be parsed.
- 232 • R:452:ALL:NA:uniqueIdentifier
- 233 All IdentifiedObject-s shall have a persistent and globally unique identifier (Master
234 Resource Identifier - mRID).
- 235 • R:452:ALL:NA:unitMultiplier
- 236 For exchange of attributes defined using CIM Data Types (ActivePower, Susceptance,
237 etc.) a unit multiplier of 1 is used if the UnitMultiplier specified in this document is “none”.
- 238 • C:452:ALL:IdentifiedObject.name:stringLength

- 239 The string IdentifiedObject.name has a maximum of 128 characters.
- 240
- C:452:ALL:IdentifiedObject.description:stringLength
- 241 The string IdentifiedObject.description is maximum 256 characters.
- 242
- C:452:ALL:NA:float
- 243 An attribute that is defined as float (e.g. has a type Float or a type which is a Datatype
244 with .value attribute of type Float) shall support ISO/IEC 60559:2020 for floating-point
245 arithmetic using single precision floating point. A single precision float supports 7
246 significant digits where the significant digits are described as an integer, or a decimal
247 number with 6 decimal digits. Two float values are equal when the significant with 7
248 digits are identical, e.g. 1234567 is equal 1.234567E6 and so are 1.2345678 and
249 1.234567E0.
- 250
- R:CSA:ALL:Region:reference
- 251 The reference to the Region is normally a reference to the capacity calculation region,
252 which is identified by “Y” EIC code of the capacity calculation region.
- 253
- R:CSA:ALL:SystemOperator:reference
- 254 The reference to the System Operator is normally identified by “X” EIC code of TSO.
- 255
- C:CSA:CO:Contingency.RemedialAction:usageCurative
- 256 For a RemedialAction which is curative (RemedialAction.kind equals
257 RemedialActionKind.curative and RemedialActionKind.curativeAndPreventive), the
258 association Contingency.RemedialAction is required and a contingency shall be defined.
259 If RemedialAction.kind equals RemedialActionKind.preventive, the association
260 Contingency.RemedialAction shall not be exchanged and a contingency shall not be
261 defined.
- 262
- C:CSA:CO:Contingency.ContingencyElement:ordinaryContingency
- 263 The multiplicity of the association end Contingency.ContingencyElement is restricted to
264 1 for an OrdinaryContingency.
- 265
- C:CSA:CO:Contingency.ContingencyElement:outOfRangeAndExceptional
- 266 The multiplicity of the association end Contingency.ContingencyElement is restricted to
267 2..* for both OutOfRangeContingency and ExceptionalContingency.
- 268 **2.4 Metadata**
- 269 ENTSO-E agreed to extend the header and metadata definitions by IEC 61970-552 Ed2. This
270 new header definitions rely on W3C recommendations which are used worldwide and are
271 positively recognised by the European Commission. The new definitions of the header mainly
272 use Provenance ontology (PROV-O), Time Ontology and Data Catalog Vocabulary (DCAT). The
273 global new header is included in the metadata and document header specification document.
- 274 For this profile, header definitions are embedded directly in the profile. The header and the
275 payload are in principle two different profiles, but they are currently implemented as one profile
276 specification due to limitation in the current standards. With the approval of IEC 61970-501 Ed2
277 it will be possible to export it as two embedded profiles.

278 **2.4.1 Constraints**

279 The identification of the constraints related to the metadata follows the same convention for
280 naming of the constraints as for profile constraints.

- 281 • R:CSA:ALL:wasAttributedTo:usage

282 The prov:wasAttributedTo should normally be the “X” EIC code of the actor (prov:Agent).

283


284 **2.4.2 Reference metadata**

285 The header defined for this profile requires availability of a set of reference metadata. For
286 instance, the attribute prov:wasGeneratedBy requires a reference to an activity which produced
287 the model or the related process. The activities are defined as reference metadata and their
288 identifiers are referenced from the header to enable the receiving entity to retrieve the “static”
289 (reference) information that it is not modified frequently. This approach imposes a requirement
290 that both the sending entity and the receiving entity have access to a unique version of the
291 reference metadata. Therefore, each business process shall define which reference metadata
292 is used and where it is located.

293 **3 Detailed Profile Specification**

294 **3.1 General**


295 This package contains contingency profile.

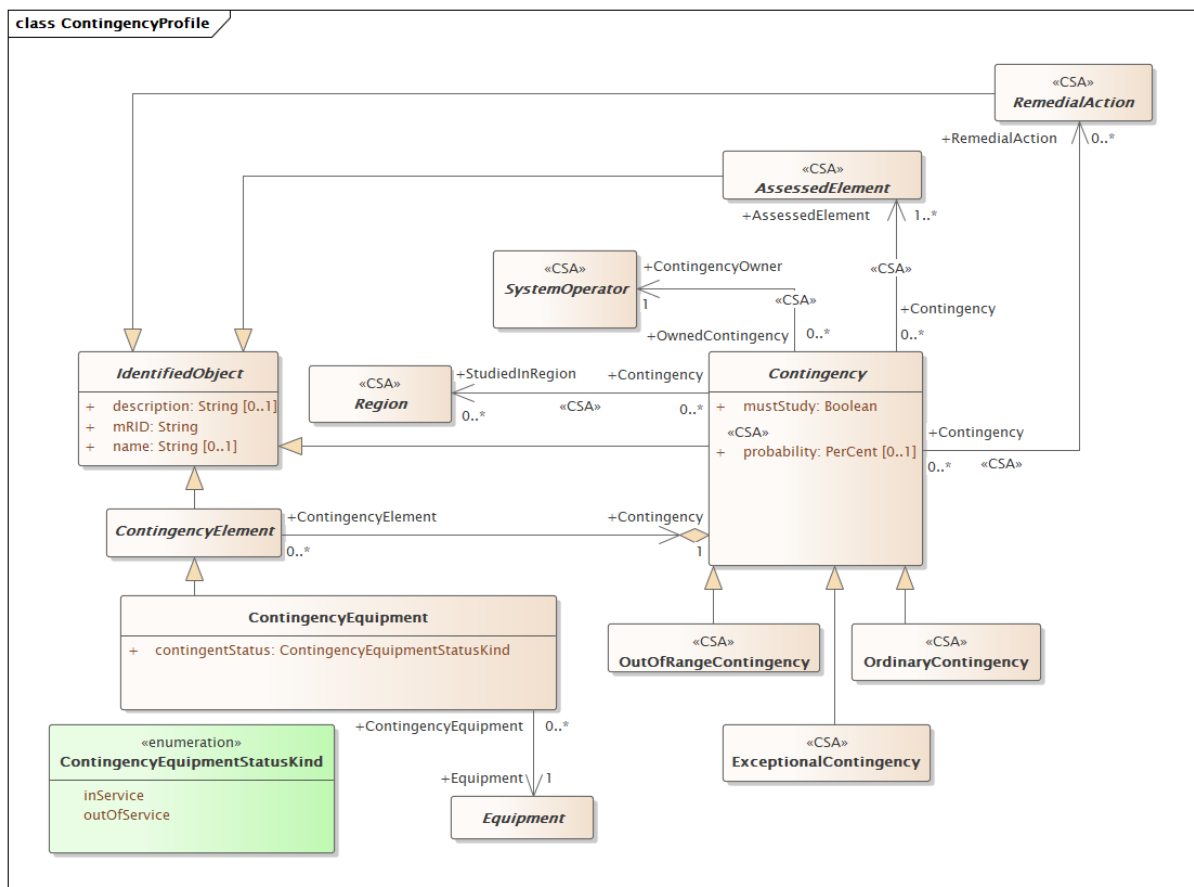

296


297 **Figure 1 – Class diagram ContingencyProfile::ContingencyProfile**

298 Figure 1: The diagram contains the main classes used in the profile.

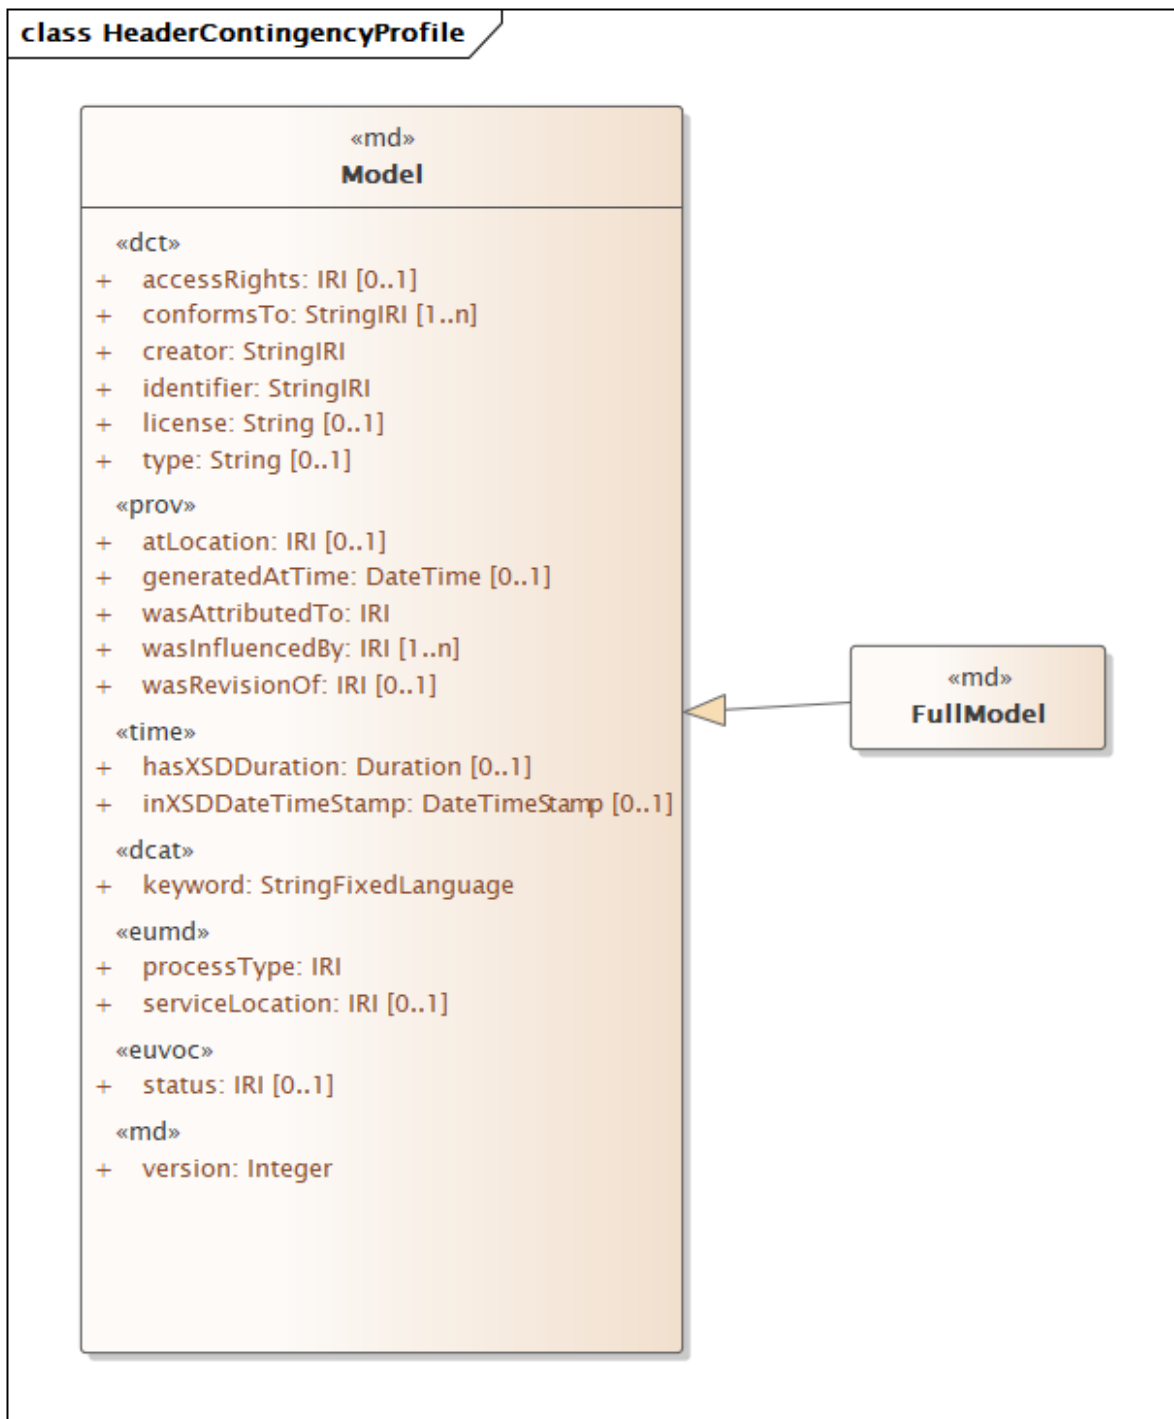

299
300 **Figure 2 – Class diagram ContingencyProfile::HeaderContingencyProfile**

301 Figure 2: The diagram contains classes related to the header.

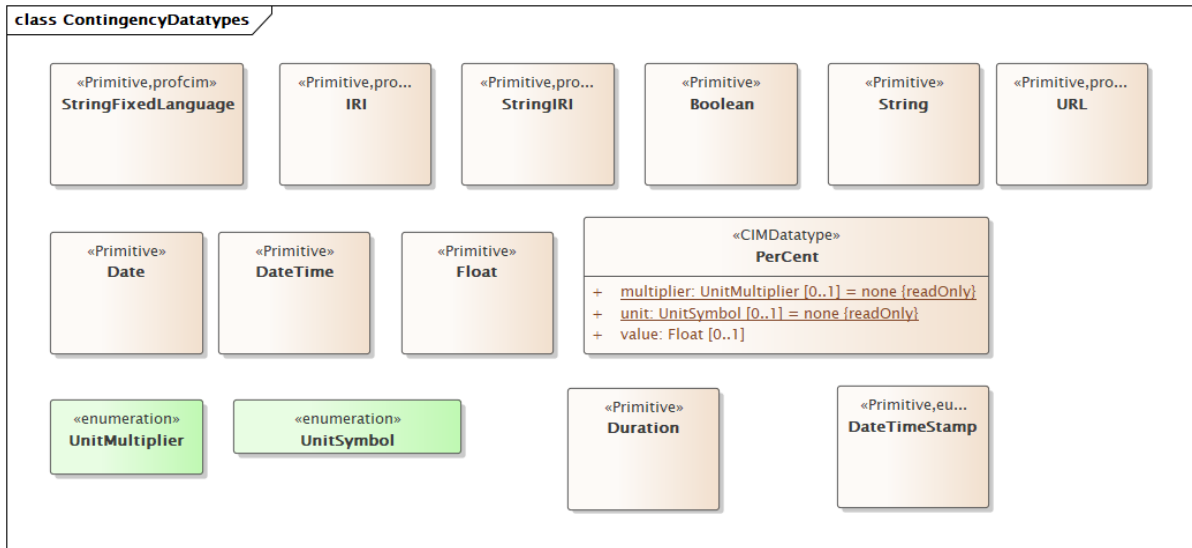

302

303

Figure 3 – Class diagram ContingencyProfile::ContingencyDatatypes

304 Figure 3: The diagram shows datatypes that are used by classes in the profile. Stereotypes are
305 used to describe the datatypes. The following stereotypes are defined:

306 <<enumeration>> A list of permissible constant values.

307 <<Primitive>> The most basic data types used to compose all other data types.

308 <<CIMDatatype>> A datatype that contains a value attribute, an optional unit of measure and
309 a unit multiplier. The unit and multiplier may be specified as a static variable initialized to the
310 allowed value.

311 <<Compound>> A composite of Primitive, enumeration, CIMDatatype or other Compound
312 classes, as long as the Compound classes do not recurse.

313 For all datatypes both positive and negative values are allowed unless stated otherwise for a
314 particular datatype.

315 **3.2 (md) FullModel**

316 Inheritance path = [Model](#)

317 It represents the full model header and its contents is described by the Model class.

318 Table 1 shows all attributes of FullModel.

319

Table 1 – Attributes of ContingencyProfile::FullModel

name	mult	type	description
version	1..1	Integer	(md) inherited from: Model
status	0..1	IRI	(euvoc) inherited from: Model
keyword	1..1	StringFixedLanguage	(dcat) inherited from: Model
accessRights	0..1	IRI	(dct) inherited from: Model
conformsTo	1..n	StringIRI	(dct) inherited from: Model
identifier	1..1	StringIRI	(dct) inherited from: Model
license	0..1	String	(dct) inherited from: Model
type	0..1	String	(dct) inherited from: Model
generatedAtTime	0..1	DateTime	(prov) inherited from: Model
atLocation	0..1	IRI	(prov) inherited from: Model
wasInfluencedBy	1..n	IRI	(prov) inherited from: Model
wasAttributedTo	1..1	IRI	(prov) inherited from: Model

name	mult	type	description
wasRevisionOf	0..1	IRI	(prov) inherited from: Model
inXSDDateTimeStamp	0..1	DateTimeStamp	(time) inherited from: Model
hasXSDDuration	0..1	Duration	(time) inherited from: Model
processType	1..1	IRI	(eumd) inherited from: Model
creator	1..1	StringIRI	(dct) inherited from: Model
serviceLocation	0..1	IRI	(eumd) inherited from: Model

320

3.3 (md) Model root class

322 A Model is a collection of data describing instances, objects or entities, real or computed. In
323 the context of CIM the semantics of the data is defined by profiles. Hence a model can contain
324 equipment data, power flow initial values, power flow results etc.

325 The Model class describes the header content that is the same for the FullModel and the
326 DifferenceModel. A Model is identified by an rdf:about attribute. The rdf:about attribute uniquely
327 describes the model data and not the CIMXML document. A new rdf:about identification is
328 generated for created documents only when the model data has changed. A repeated creation
329 of documents from unchanged model data shall have the same rdf:about identification as
330 previous document generated from the same model data.

331 Table 2 shows all attributes of Model.

332

Table 2 – Attributes of ContingencyProfile::Model

name	mult	type	description
version	1..1	Integer	(md) The version of the model. If the instance file is imported and exported with no change, the version number is kept the same. The version changes only if the content of the file changes. It is the same logic as for the header id. The version is the human readable id. [CIM context: It relates to the version of the document and not the version of the model which is serialized.]
status	0..1	IRI	(euvoc) Indicates the status of a skos:Concept or a skosxl:Label, or any resource related to controlled vocabulary management. [CIM context: The condition or position of an object with regard to its standing. (Validated, Primary, Backup etc.)].
keyword	1..1	StringFixedLanguage	(dcat) A keyword or tag describing a resource. [CIM context: The intended content type of the model, usually the profile keyword. Used to identify what profiles and content is expected in the document, e.g., Equipment, Boundary, SSH, AE, etc. The same keyword is used for different versions of same profile. It can be also used to identify different content based on the same profile. For instance, as the equipment profile can be used for both boundary data and equipment not related to boundary, the keyword is different to indicate that boundary data is exchanged. In order to avoid ambiguity the property is not exchanged in cases where the document contains multiple profiles referenced by dct:conformsTo.]

name	mult	type	description
accessRights	0..1	IRI	(dct) Information about who access the resource or an indication of its security status. Access Rights may include information regarding access or restrictions based on privacy, security, or other policies. [CIM context: Reference to the confidentiality level that shall be applied when handling this model.]
conformsTo	1..n	StringIRI	(dct) An established standard to which the described resource conforms. [CIM context: An IRI describing the profile that governs this model. It uniquely identifies the profile and its version. Multiple instances of the property describe all standards or specifications to which the model and the document representing this model conform to. A document would normally conform to profile definitions, the constraints that relate to the profile and/or the set of business specific constraints. A reference to a machine- readable constraints or specification indicates that the document was tested against these constraints and it conforms to them.]
identifier	1..1	StringIRI	(dct) An unambiguous reference to the resource within a given context. Recommended practice is to identify the resource by means of a string conforming to an identification system. Examples include International Standard Book Number (ISBN), Digital Object Identifier (DOI), and Uniform Resource Name (URN). Persistent identifiers should be provided as HTTP URIs. [CIM context: A unique identifier of the model which is serialised in the document where the header is located. The identifier is persistent for a given version of the model and shall change when the model changes. If a model is serialized as complete (full) model or as difference model exchange the identifier shall be the same. The identifier shall not be used as an identifier of the document which can be different for a given version of a model.]
license	0..1	String	(dct) A legal document giving official permission to do something with the resource. Recommended practice is to identify the license document with a URI. If this is not possible or feasible, a literal value that identifies the license may be provided. [CIM context: Reference to the license under which the data is made available. If no license holder is defined, then the original data provider holds the license.]
type	0..1	String	(dct) The nature or genre of the resource. Recommended practice is to use a controlled vocabulary such as the DCMI Type Vocabulary [DCMI-TYPE]. To describe the file format, physical medium, or dimensions of the resource, use the property Format.
generatedAtTime	0..1	DateTime	(prov) Generation is the completion of production of a new entity by an activity. This entity did not

name	mult	type	description
			<p>exist before generation and becomes available for usage after this generation.</p> <p>[CIM context: The date and time when the model was serialized in the document where the header is located. The format is an extended format according to the ISO 8601-2005. European exchanges shall refer to UTC.]</p>
atLocation	0..1	IRI	<p>(prov) A location can be an identifiable geographic place (ISO 19112), but it can also be a non-geographic place such as a directory, row, or column. As such, there are numerous ways in which location can be expressed, such as by a coordinate, address, landmark, and so forth.</p> <p>[CIM context: Reference to a region or a domain for which this model is provided.]</p>
wasInfluencedBy	1..n	IRI	<p>(prov) Influence is the capacity of an entity, activity, or agent to have an effect on the character, development, or behavior of another by means of usage, start, end, generation, invalidation, communication, derivation, attribution, association, or delegation.</p> <p>[CIM context: A reference to the model on which the model serialised in this document depends on. The references are maintained by the producer of the model. Minimum requirements for the dependency are specified and can be restricted within a business process as long as they do not contradict requirements by standards. For instance, IEC 61970-600-1 defines minimum requirements for the profiles defined in that standard.]</p>
wasAttributedTo	1..1	IRI	<p>(prov) Attribution is the ascribing of an entity to an agent.</p> <p>[CIM context: Reference to the agent (or service provider) from which the model originates.]</p>
wasRevisionOf	0..1	IRI	<p>(prov) A revision is a derivation for which the resulting entity is a revised version of some original. The implication here is that the resulting entity contains substantial content from the original. Revision is a particular case of derivation.</p> <p>[CIM context: When a model is updated the resulting model supersedes the models that were used as basis for the update. Hence this is a reference to the model which are superseded by this model. A model can supersede 1 or more models, e.g. a difference model or a full model supersede multiple models (difference or full). In this case, multiple properties are included in the header. The referenced document(s) is (are) identified by the URN/MRID/UUID in the FullModel rdf:about attribute when full model(s) is (are) referenced and by the URN/MRID/UUID in the DifferenceModel rdf:about attribute when difference model(s) is (are) referenced.]</p>
inXSDDateTimeStamp	0..1	DateTimeStamp	<p>(time) Position of an instant, expressed using xsd:dateTimeStamp, in which the time-zone field is mandatory.</p>

name	mult	type	description
			[CIM context: The date and time that this model represents, i.e. for which the model is (or was) valid. If used in relation with hasXSDDuration it indicates the beginning of the validity period. It is indicating either an instant (in cases where the model is only valid for a point in time) or the start time of a period. If not provided the model is considered valid for any time stamp. The format is an extended format according to the ISO 8601-2005. European exchanges shall refer to UTC.].
hasXSDDuration	0..1	Duration	(time) Extent of a temporal entity, expressed using xsd:duration. [CIM context: The duration of the validity period of the model that it is serialized in the document where the header is located. It is only used in relation to the inXSDDateTimeStamp property which indicates the beginning of the validity period of the model. The end of the validity period is derived from both inXSDDateTimeStamp and hasXSDDuration.].
processType	1..1	IRI	(eumd) The exact business nature. Reference to Business Process configurations.
creator	1..1	StringIRI	(dct) An entity responsible for making the resource. Recommended practice is to identify the creator with a URI. If this is not possible or feasible, a literal value that identifies the creator may be provided. [CIM context: The name of the agent (Modeling Authority) from which the model originates].
serviceLocation	0..1	IRI	(eumd) Reference to a service location (region or a domain).

333

334 **3.4 (abstract,CSA) Region root class**

335 A region where the system operator belongs to.

336 **3.5 (abstract,CSA) SystemOperator root class**

337 System operator.

338 **3.6 (abstract,CSA) AssessedElement**339 Inheritance path = [IdentifiedObject](#)

340 Assessed element is a network element for which the electrical state is evaluated in the regional or cross-regional process and which value is expected to fulfil regional rules function of the operational security limits.

343 The information of the validity period of the assessed element is derived from the conducting equipment.

345 The measurements and limits are as defined in the steady state hypothesis.

346 Table 3 shows all attributes of AssessedElement.

347

Table 3 – Attributes of ContingencyProfile::AssessedElement

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject

name	mult	type	description
name	0..1	String	inherited from: IdentifiedObject

348

349 3.7 (abstract) Contingency

350 Inheritance path = [IdentifiedObject](#)

351 An event threatening system reliability, consisting of one or more contingency elements.

352 Table 4 shows all attributes of Contingency.

353

Table 4 – Attributes of ContingencyProfile::Contingency

name	mult	type	description
mustStudy	1..1	Boolean	Set true if must study this contingency.
probability	0..1	PerCent	(CSA) Probability of occurrence.
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

354

355 Table 5 shows all association ends of Contingency with other classes.

356

Table 5 – Association ends of ContingencyProfile::Contingency with other classes

mult from	name	mult to	type	description
0..*	StudiedInRegion	0..*	Region	(CSA) The region which applies the contingency.
0..*	AssessedElement	1..*	AssessedElement	(CSA) The assessed element defined for this contingency.
0..*	ContingencyOwner	1..1	SystemOperator	(CSA) System operator owning this contingency.
0..*	RemedialAction	0..*	RemedialAction	(CSA) The remedial action that has a contingency.

357

358 3.8 (abstract) ContingencyElement

359 Inheritance path = [IdentifiedObject](#)

360 An element of a system event to be studied by contingency analysis, representing a change in status of a single piece of equipment.

362 Table 6 shows all attributes of ContingencyElement.

363

Table 6 – Attributes of ContingencyProfile::ContingencyElement

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

364

365 Table 7 shows all association ends of ContingencyElement with other classes.

366 **Table 7 – Association ends of ContingencyProfile::ContingencyElement with other**
367 **classes**

mult from	name	mult to	type	description
0..*	Contingency	1..1	Contingency	A contingency element belongs to one contingency.

368

369 3.9 ContingencyEquipment

370 Inheritance path = [ContingencyElement](#) : [IdentifiedObject](#)

371 Equipment whose in service status is to change, such as a power transformer or AC line
372 segment.

373 Table 8 shows all attributes of ContingencyEquipment.

374 **Table 8 – Attributes of ContingencyProfile::ContingencyEquipment**

name	mult	type	description
contingentStatus	1..1	ContingencyEquipmentStatusKind	The status for the associated equipment when in the contingency state. This status is independent of the case to which the contingency is originally applied, but defines the equipment status when the contingency is applied.
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

375

376 Table 9 shows all association ends of ContingencyEquipment with other classes.

377 **Table 9 – Association ends of ContingencyProfile::ContingencyEquipment with other**
378 **classes**

mult from	name	mult to	type	description
0..*	Equipment	1..1	Equipment	The single piece of equipment to which to apply the contingency.
0..*	Contingency	1..1	Contingency	inherited from: ContingencyElement

379

380 3.10 (abstract) Equipment root class

381 The parts of a power system that are physical devices, electronic or mechanical.

382 3.11 (CSA) ExceptionalContingency

383 Inheritance path = [Contingency](#) : [IdentifiedObject](#)

384 Exceptional contingency means the simultaneous occurrence of multiple contingencies with a
385 common cause.

386 Table 10 shows all attributes of ExceptionalContingency.

387 **Table 10 – Attributes of ContingencyProfile::ExceptionalContingency**

name	mult	type	description
mustStudy	1..1	Boolean	inherited from: Contingency
probability	0..1	PerCent	(CSA) inherited from: Contingency
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject

name	mult	type	description
name	0..1	String	inherited from: IdentifiedObject

388

389

Table 11 shows all association ends of ExceptionalContingency with other classes.

390

Table 11 – Association ends of ContingencyProfile::ExceptionalContingency with other classes

391

mult from	name	mult to	type	description
0..*	StudiedInRegion	0..*	Region	(CSA) inherited from: Contingency
0..*	AssessedElement	1..*	AssessedElement	(CSA) inherited from: Contingency
0..*	ContingencyOwner	1..1	SystemOperator	(CSA) inherited from: Contingency
0..*	RemedialAction	0..*	RemedialAction	(CSA) inherited from: Contingency

392

393

3.12 (abstract) IdentifiedObject root class

394

This is a root class to provide common identification for all classes needing identification and naming attributes.

395

396

Table 12 shows all attributes of IdentifiedObject.

397

Table 12 – Attributes of ContingencyProfile::IdentifiedObject

name	mult	type	description
description	0..1	String	The description is a free human readable text describing or naming the object. It may be non unique and may not correlate to a naming hierarchy.
mRID	1..1	String	Master resource identifier issued by a model authority. The mRID is unique within an exchange context. Global uniqueness is easily achieved by using a UUID, as specified in RFC 4122, for the mRID. The use of UUID is strongly recommended. For CIMXML data files in RDF syntax conforming to IEC 61970-552, the mRID is mapped to rdf:ID or rdf:about attributes that identify CIM object elements.
name	0..1	String	The name is any free human readable and possibly non unique text naming the object.

398

399

3.13 (CSA) OrdinaryContingency

400

Inheritance path = [Contingency](#) : [IdentifiedObject](#)

401

Ordinary contingency means the occurrence of a contingency of a single branch or injection.

402

Table 13 shows all attributes of OrdinaryContingency.

403

Table 13 – Attributes of ContingencyProfile::OrdinaryContingency

name	mult	type	description
mustStudy	1..1	Boolean	inherited from: Contingency
probability	0..1	PerCent	(CSA) inherited from: Contingency
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

404

405 Table 14 shows all association ends of OrdinaryContingency with other classes.

406 **Table 14 – Association ends of ContingencyProfile::OrdinaryContingency with other**
407 **classes**

mult from	name	mult to	type	description
0..*	StudiedInRegion	0..*	Region	(CSA) inherited from: Contingency
0..*	AssessedElement	1..*	AssessedElement	(CSA) inherited from: Contingency
0..*	ContingencyOwner	1..1	SystemOperator	(CSA) inherited from: Contingency
0..*	RemedialAction	0..*	RemedialAction	(CSA) inherited from: Contingency

408

409 3.14 (CSA) OutOfRangeContingency

410 Inheritance path = [Contingency](#) : [IdentifiedObject](#)

411 Out of range means the simultaneous occurrence of multiple contingencies without a common
412 cause, or a loss of power generating modules with a total loss of generation capacity exceeding
413 the reference incident.

414 Table 15 shows all attributes of OutOfRangeContingency.

415 **Table 15 – Attributes of ContingencyProfile::OutOfRangeContingency**

name	mult	type	description
mustStudy	1..1	Boolean	inherited from: Contingency
probability	0..1	PerCent	(CSA) inherited from: Contingency
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

416

417 Table 16 shows all association ends of OutOfRangeContingency with other classes.

418 **Table 16 – Association ends of ContingencyProfile::OutOfRangeContingency with other**
419 **classes**

mult from	name	mult to	type	description
0..*	StudiedInRegion	0..*	Region	(CSA) inherited from: Contingency
0..*	AssessedElement	1..*	AssessedElement	(CSA) inherited from: Contingency
0..*	ContingencyOwner	1..1	SystemOperator	(CSA) inherited from: Contingency
0..*	RemedialAction	0..*	RemedialAction	(CSA) inherited from: Contingency

420

421 3.15 (abstract,CSA) RemedialAction

422 Inheritance path = [IdentifiedObject](#)

423 A remedial action is described by one of many grid state alterations applied to a grid model
424 state or particular scenario in order to resolve one or more Identified constraints. Only costly
425 remedial actions require a cost characteristic.

426 Table 17 shows all attributes of RemedialAction.

427 **Table 17 – Attributes of ContingencyProfile::RemedialAction**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject

name	mult	type	description
name	0..1	String	inherited from: IdentifiedObject

428

429 **3.16 UnitMultiplier enumeration**

430 The unit multipliers defined for the CIM. When applied to unit symbols, the unit symbol is
431 treated as a derived unit. Regardless of the contents of the unit symbol text, the unit symbol
432 shall be treated as if it were a single-character unit symbol. Unit symbols should not contain
433 multipliers, and it should be left to the multiplier to define the multiple for an entire data type.

434 For example, if a unit symbol is "m2Pers" and the multiplier is "k", then the value is k(m**2/s),
435 and the multiplier applies to the entire final value, not to any individual part of the value. This
436 can be conceptualized by substituting a derived unit symbol for the unit type. If one imagines
437 that the symbol "P" represents the derived unit "m2Pers", then applying the multiplier "k" can
438 be conceptualized simply as "kP".

439 For example, the SI unit for mass is "kg" and not "g". If the unit symbol is defined as "kg", then
440 the multiplier is applied to "kg" as a whole and does not replace the "k" in front of the "g". In
441 this case, the multiplier of "m" would be used with the unit symbol of "kg" to represent one gram.
442 As a text string, this violates the instructions in IEC 80000-1. However, because the unit symbol
443 in CIM is treated as a derived unit instead of as an SI unit, it makes more sense to conceptualize
444 the "kg" as if it were replaced by one of the proposed replacements for the SI mass symbol. If
445 one imagines that the "kg" were replaced by a symbol "P", then it is easier to conceptualize the
446 multiplier "m" as creating the proper unit "mP", and not the forbidden unit "mkg".

447 Table 18 shows all literals of UnitMultiplier.

448

Table 18 – Literals of ContingencyProfile::UnitMultiplier

literal	value	description
y	-24	Yocto 10**-24.
z	-21	Zepto 10**-21.
a	-18	Atto 10**-18.
f	-15	Femto 10**-15.
p	-12	Pico 10**-12.
n	-9	Nano 10**-9.
micro	-6	Micro 10**-6.
m	-3	Milli 10**-3.
c	-2	Centi 10**-2.
d	-1	Deci 10**-1.
none	0	No multiplier or equivalently multiply by 1.
da	1	Deca 10**1.
h	2	Hecto 10**2.
k	3	Kilo 10**3.
M	6	Mega 10**6.
G	9	Giga 10**9.
T	12	Tera 10**12.
P	15	Peta 10**15.
E	18	Exa 10**18.
Z	21	Zetta 10**21.
Y	24	Yotta 10**24.

449

450 **3.17 UnitSymbol enumeration**

451 The derived units defined for usage in the CIM. In some cases, the derived unit is equal to an
452 SI unit. Whenever possible, the standard derived symbol is used instead of the formula for the
453 derived unit. For example, the unit symbol Farad is defined as "F" instead of "CPerV". In cases
454 where a standard symbol does not exist for a derived unit, the formula for the unit is used as
455 the unit symbol. For example, density does not have a standard symbol and so it is represented
456 as "kgPerm3". With the exception of the "kg", which is an SI unit, the unit symbols do not contain
457 multipliers and therefore represent the base derived unit to which a multiplier can be applied as
458 a whole.

459 Every unit symbol is treated as an unparseable text as if it were a single-letter symbol. The
460 meaning of each unit symbol is defined by the accompanying descriptive text and not by the
461 text contents of the unit symbol.

462 To allow the widest possible range of serializations without requiring special character handling,
463 several substitutions are made which deviate from the format described in IEC 80000-1. The
464 division symbol "/" is replaced by the letters "Per". Exponents are written in plain text after the
465 unit as "m3" instead of being formatted as "m" with a superscript of 3 or introducing a symbol
466 as in "m^3". The degree symbol "°" is replaced with the letters "deg". Any clarification of the
467 meaning for a substitution is included in the description for the unit symbol.

468 Non-SI units are included in list of unit symbols to allow sources of data to be correctly labelled
469 with their non-SI units (for example, a GPS sensor that is reporting numbers that represent feet
470 instead of meters). This allows software to use the unit symbol information correctly convert
471 and scale the raw data of those sources into SI-based units.

472 The integer values are used for harmonization with IEC 61850.

473 Table 19 shows all literals of UnitSymbol.

474

Table 19 – Literals of ContingencyProfile::UnitSymbol

literal	value	description
none	0	Dimension less quantity, e.g. count, per unit, etc.
m	2	Length in metres.
kg	3	Mass in kilograms. Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
s	4	Time in seconds.
A	5	Current in amperes.
K	6	Temperature in kelvins.
mol	7	Amount of substance in moles.
cd	8	Luminous intensity in candelas.
deg	9	Plane angle in degrees.
rad	10	Plane angle in radians (m/m).
sr	11	Solid angle in steradians (m ² /m ²).
Gy	21	Absorbed dose in grays (J/kg).
Bq	22	Radioactivity in becquerels (1/s).
degC	23	Relative temperature in degrees Celsius. In the SI unit system the symbol is °C. Electric charge is measured in coulomb that has the unit symbol C. To distinguish degree Celsius from coulomb the symbol used in the UML is degC. The reason for not using °C is that the special character ° is difficult to manage in software.
Sv	24	Dose equivalent in sieverts (J/kg).
F	25	Electric capacitance in farads (C/V).

literal	value	description
C	26	Electric charge in coulombs (A·s).
S	27	Conductance in siemens.
H	28	Electric inductance in henrys (Wb/A).
V	29	Electric potential in volts (W/A).
ohm	30	Electric resistance in ohms (V/A).
J	31	Energy in joules (N·m = C·V = W·s).
N	32	Force in newtons (kg·m/s ²).
Hz	33	Frequency in hertz (1/s).
lx	34	Illuminance in lux (lm/m ²).
lm	35	Luminous flux in lumens (cd·sr).
Wb	36	Magnetic flux in webers (V·s).
T	37	Magnetic flux density in teslas (Wb/m ²).
W	38	Real power in watts (J/s). Electrical power may have real and reactive components. The real portion of electrical power (I^2R or $V\cos(\phi)$), is expressed in Watts. See also apparent power and reactive power.
Pa	39	Pressure in pascals (N/m ²). Note: the absolute or relative measurement of pressure is implied with this entry. See below for more explicit forms.
m2	41	Area in square metres (m ²).
m3	42	Volume in cubic metres (m ³).
mPers	43	Velocity in metres per second (m/s).
mPers2	44	Acceleration in metres per second squared (m/s ²).
m3Pers	45	Volumetric flow rate in cubic metres per second (m ³ /s).
mPerm3	46	Fuel efficiency in metres per cubic metres (m/m ³).
kgm	47	Moment of mass in kilogram metres (kg·m) (first moment of mass). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
kgPerm3	48	Density in kilogram/cubic metres (kg/m ³). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
m2Pers	49	Viscosity in square metres / second (m ² /s).
WPermK	50	Thermal conductivity in watt/metres kelvin.
JPerK	51	Heat capacity in joules/kelvin.
ppm	52	Concentration in parts per million.
rotPers	53	Rotations per second (1/s). See also Hz (1/s).
radPers	54	Angular velocity in radians per second (rad/s).
WPerm2	55	Heat flux density, irradiance, watts per square metre.
JPerm2	56	Insulation energy density, joules per square metre or watt second per square metre.
SPerm	57	Conductance per length (F/m).

literal	value	description
KPers	58	Temperature change rate in kelvins per second.
PaPers	59	Pressure change rate in pascals per second.
JPerkgK	60	Specific heat capacity, specific entropy, joules per kilogram Kelvin.
VA	61	Apparent power in volt amperes. See also real power and reactive power.
VAr	63	Reactive power in volt amperes reactive. The “reactive” or “imaginary” component of electrical power ($V\sin(\phi)$). (See also real power and apparent power). Note: Different meter designs use different methods to arrive at their results. Some meters may compute reactive power as an arithmetic value, while others compute the value vectorially. The data consumer should determine the method in use and the suitability of the measurement for the intended purpose.
cosPhi	65	Power factor, dimensionless. Note 1: This definition of power factor only holds for balanced systems. See the alternative definition under code 153. Note 2 : Beware of differing sign conventions in use between the IEC and EEI. It is assumed that the data consumer understands the type of meter in use and the sign convention in use by the utility.
Vs	66	Volt seconds (Ws/A).
V2	67	Volt squared (W^2/A^2).
As	68	Ampere seconds (A·s).
A2	69	Amperes squared (A^2).
A2s	70	Ampere squared time in square amperes (A^2s).
VAh	71	Apparent energy in volt ampere hours.
Wh	72	Real energy in watt hours.
VArh	73	Reactive energy in volt ampere reactive hours.
VPerHz	74	Magnetic flux in volt per hertz.
HzPers	75	Rate of change of frequency in hertz per second.
character	76	Number of characters.
charPers	77	Data rate (baud) in characters per second.
kgm2	78	Moment of mass in kilogram square metres ($kg\cdot m^2$) (Second moment of mass, commonly called the moment of inertia). Note: multiplier “k” is included in this unit symbol for compatibility with IEC 61850-7-3.
dB	79	Sound pressure level in decibels. Note: multiplier “d” is included in this unit symbol for compatibility with IEC 61850-7-3.
WPers	81	Ramp rate in watts per second.
IPers	82	Volumetric flow rate in litres per second.
dBm	83	Power level (logarithmic ratio of signal strength , Bel-mW), normalized to 1mW. Note: multiplier “d” is included in this unit symbol for compatibility with IEC 61850-7-3.

literal	value	description
h	84	Time in hours, hour = 60 min = 3600 s.
min	85	Time in minutes, minute = 60 s.
Q	100	Quantity power, Q.
Qh	101	Quantity energy, Qh.
ohmm	102	Resistivity, ohm metres, (rho).
APerm	103	A/m, magnetic field strength, amperes per metre.
V2h	104	Volt-squared hour, volt-squared-hours.
A2h	105	Ampere-squared hour, ampere-squared hour.
Ah	106	Ampere-hours, ampere-hours.
count	111	Amount of substance, Counter value.
ft3	119	Volume, cubic feet.
m3Perh	125	Volumetric flow rate, cubic metres per hour.
gal	128	Volume in gallons, US gallon (1 gal = 231 in3 = 128 fl ounce).
Btu	132	Energy, British Thermal Units.
l	134	Volume in litres, litre = dm3 = m3/1000.
lPerh	137	Volumetric flow rate, litres per hour.
lPerl	143	Concentration, The ratio of the volume of a solute divided by the volume of the solution. Note: Users may need use a prefix such a 'µ' to express a quantity such as 'µL/L'.
gPerg	144	Concentration, The ratio of the mass of a solute divided by the mass of the solution. Note: Users may need use a prefix such a 'µ' to express a quantity such as 'µg/g'.
molPerm3	145	Concentration, The amount of substance concentration, (c), the amount of solvent in moles divided by the volume of solution in m ³ .
molPermol	146	Concentration, Molar fraction, the ratio of the molar amount of a solute divided by the molar amount of the solution.
molPerkg	147	Concentration, Molality, the amount of solute in moles and the amount of solvent in kilograms.
sPers	149	Time, Ratio of time. Note: Users may need to supply a prefix such as 'µ' to show rates such as 'µs/s'.
HzPerHz	150	Frequency, rate of frequency change. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mHz/Hz'.
VPerV	151	Voltage, ratio of voltages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mV/V'.
APerA	152	Current, ratio of amperages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mA/A'.
VPerVA	153	Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.

literal	value	description
rev	154	Amount of rotation, revolutions.
kat	158	Catalytic activity, katal = mol / s.
JPerkg	165	Specific energy, Joules / kg.
m3Uncompensated	166	Volume, cubic metres, with the value uncompensated for weather effects.
m3Compensated	167	Volume, cubic metres, with the value compensated for weather effects.
WPerW	168	Signal Strength, ratio of power. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mW/W'.
therm	169	Energy, therms.
onePerm	173	Wavenumber, reciprocal metres, (1/m).
m3Perkg	174	Specific volume, cubic metres per kilogram, v.
Pas	175	Dynamic viscosity, pascal seconds.
Nm	176	Moment of force, newton metres.
NPerm	177	Surface tension, newton per metre.
radPers2	178	Angular acceleration, radians per second squared.
JPerm3	181	Energy density, joules per cubic metre.
VPerm	182	Electric field strength, volts per metre.
CPerm3	183	Electric charge density, coulombs per cubic metre.
CPerm2	184	Surface charge density, coulombs per square metre.
FPerm	185	Permittivity, farads per metre.
HPerm	186	Permeability, henrys per metre.
JPermol	187	Molar energy, joules per mole.
JPermolK	188	Molar entropy, molar heat capacity, joules per mole kelvin.
CPerkg	189	Exposure (x rays), coulombs per kilogram.
GyPers	190	Absorbed dose rate, grays per second.
WPersr	191	Radiant intensity, watts per steradian.
WPerm2sr	192	Radiance, watts per square metre steradian.
katPerm3	193	Catalytic activity concentration, katals per cubic metre.
d	195	Time in days, day = 24 h = 86400 s.
anglemin	196	Plane angle, minutes.
anglesec	197	Plane angle, seconds.
ha	198	Area, hectares.
tonne	199	Mass in tons, "tonne" or "metric ton" (1000 kg = 1 Mg).
bar	214	Pressure in bars, (1 bar = 100 kPa).
mmHg	215	Pressure, millimetres of mercury (1 mmHg is approximately 133.3 Pa).
M	217	Length, nautical miles (1 M = 1852 m).

literal	value	description
kn	219	Speed, knots (1 kn = 1852/3600) m/s.
Mx	276	Magnetic flux, maxwells (1 Mx = 10 ⁻⁸ Wb).
G	277	Magnetic flux density, gaussses (1 G = 10 ⁻⁴ T).
Oe	278	Magnetic field in oersteds, (1 Oe = (103/4π) A/m).
Vh	280	Volt-hour, Volt hours.
WPerA		Active power per current flow, watts per Ampere.
onePerHz		Reciprocal of frequency (1/Hz).
VPerVAr		Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.
ohmPerm	86	Electric resistance per length in ohms per metre ((V/A)/m).
kgPerJ		Weight per energy in kilograms per joule (kg/J). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
JPers		Energy rate in joules per second (J/s).

475

476 3.18 ContingencyEquipmentStatusKind enumeration

477 Indicates the state which the contingency equipment is to be in when the contingency is applied.

478 Table 20 shows all literals of ContingencyEquipmentStatusKind.

479 **Table 20 – Literals of ContingencyProfile::ContingencyEquipmentStatusKind**

literal	value	description
inService		The equipment is to be put into service.
outOfService		The equipment is to be taken out of service.

480

481 3.19 PerCent datatype

482 Percentage on a defined base. For example, specify as 100 to indicate at the defined base.

483 Table 21 shows all attributes of PerCent.

484 **Table 21 – Attributes of ContingencyProfile::PerCent**

name	mult	type	description
value	0..1	Float	Normally 0 to 100 on a defined base.
unit	0..1	UnitSymbol	(const=none)
multiplier	0..1	UnitMultiplier	(const=none)

485

486 3.20 Boolean primitive

487 A type with the value space "true" and "false".

488 3.21 Date primitive

489 Date as "yyyy-mm-dd", which conforms with ISO 8601. UTC time zone is specified as "yyyy-mm-ddZ". A local timezone relative UTC is specified as "yyyy-mm-dd(+/-)hh:mm".

490

491 3.22 DateTime primitive

492 Date and time as "yyyy-mm-ddThh:mm:ss.sss", which conforms with ISO 8601. UTC time zone
493 is specified as "yyyy-mm-ddThh:mm:ss.sssZ". A local timezone relative UTC is specified as
494 "yyyy-mm-ddThh:mm:ss.sss-hh:mm". The second component (shown here as "ss.sss") could
495 have any number of digits in its fractional part to allow any kind of precision beyond seconds.

496 3.23 (eumd) DateTimeStamp primitive

497 Position of an instant, expressed using xsd:dateTimeStamp, in which the time-zone field is
498 mandatory.

499 3.24 Duration primitive

500 Duration as "PnYnMnDTnHnMnS" which conforms to ISO 8601, where nY expresses a number
501 of years, nM a number of months, nD a number of days. The letter T separates the date
502 expression from the time expression and, after it, nH identifies a number of hours, nM a number
503 of minutes and nS a number of seconds. The number of seconds could be expressed as a
504 decimal number, but all other numbers are integers.

505 3.25 Float primitive

506 A floating point number. The range is unspecified and not limited.

507 3.26 String primitive

508 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
509 length is unspecified and unlimited.

510 3.27 (profcim) IRI primitive

511 An IRI (Internationalized Resource Identifier) within an RDF graph is a Unicode string that
512 conforms to the syntax defined in RFC 3987.

513 The primitive is serialized as rdf:resource in RDFXML.

514 IRIs in the RDF abstract syntax must be absolute, and may contain a fragment identifier.

515 IRI equality: Two IRIs are equal if and only if they are equivalent under Simple String
516 Comparison according to section 5.1 of [RFC3987]. Further normalization must not be
517 performed when comparing IRIs for equality.

518 IRIs are a generalization of URIs [RFC3986] that permits a wider range of Unicode characters.

519 Every absolute URI and URL is an IRI, but not every IRI is an URI. When IRIs are used in
520 operations that are only defined for URIs, they must first be converted according to the mapping
521 defined in section 3.1 of [RFC3987]. A notable example is retrieval over the HTTP protocol. The

522 mapping involves UTF-8 encoding of non-ASCII characters, %-encoding of octets not allowed
523 in URIs, and Punycode-encoding of domain names.

524 3.28 (profcim) StringFixedLanguage primitive

525 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
526 length is unspecified and unlimited.

527 The primitive is serialized as literal without language support.

528 3.29 (profcim) StringIRI primitive

529 An IRI (Internationalized Resource Identifier) within an RDF graph is a Unicode string that
530 conforms to the syntax defined in RFC 3987.

531 The primitive is serialized as literal without language support.

532 IRIs in the RDF abstract syntax must be absolute, and may contain a fragment identifier.

533 IRI equality: Two IRIs are equal if and only if they are equivalent under Simple String
534 Comparison according to section 5.1 of [RFC3987]. Further normalization must not be
535 performed when comparing IRIs for equality.

536 IRIs are a generalization of URIs [RFC3986] that permits a wider range of Unicode characters.

537 Every absolute URI and URL is an IRI, but not every IRI is an URI. When IRIs are used in
538 operations that are only defined for URIs, they must first be converted according to the mapping
539 defined in section 3.1 of [RFC3987]. A notable example is retrieval over the HTTP protocol. The

540 mapping involves UTF-8 encoding of non-ASCII characters, %-encoding of octets not allowed
541 in URIs, and Punycode-encoding of domain names.

542 **3.30 (profcim) URL primitive**

543 A Uniform Resource Locator (URL), colloquially termed a web address, is a reference to a web
544 resource that specifies its location on a computer network and a mechanism for retrieving it. A
545 URL is a specific type of Uniform Resource Identifier (URI), although many people use the two
546 terms interchangeably. URLs occur most commonly to reference web pages (http), but are also
547 used for file transfer (ftp), email (mailto), database access (JDBC), and many other applications.

548

549

550 **Annex A (informative): Sample data**551 **A.1 General**

552 This Annex is designed to illustrate the profile by using fragments of sample data. It is not meant
553 to be a complete set of examples covering all possibilities of using the profile. Defining a
554 complete set of test data is considered a separate activity to be performed for the purpose of
555 setting up interoperability testing and conformity related to this profile.

556

557 **A.2 Header**

558 <!--Header -->

559 <md:FullModel rdf:about="urn:uuid:d2630bd5-9578-4fab-9647-13991c692d07"><!-- ID of the Full Model in RDF-->

560 <!-- ID of the Full Model in Data Model-->

561 <dct:identifier>urn:uuid:d2630bd5-9578-4fab-9647-13991c692d07</dct:identifier> <!--This is an example for
562 mRID of the header -->

563 <!-- creation time of the Document -->

564 <prov:generatedAtTime>2021-01-28T17:01:03Z</prov:generatedAtTime>

565 <!-- Version of the Document -->

566 <md:version>1</md:version>

567 <!-- Validity/scenario period / delivery day [Optional]-->

568 <time:inXSDDateTimeStamp>2021-11-25T17:00:00Z</time:inXSDDateTimeStamp>

569 <time:hasXSDDuration>P1Y</time:hasXSDDuration>

570 <!-- Description -->

571 <dct:description>This is an example of assessed element</dct:description>

572 <!-- Profile, Schema or Specification -->

573 <dct:conformsTo>http://entsoe.eu/ns/CIM/Contingency-EU/1.0</dct:conformsTo>

574 <dct:conformsTo> http://entsoe.eu/ns/CIM/Contingency-EU/constraints/1.0</dct:conformsTo> <!--This is an
575 example how to refer to SHACL constraints -->

576 <!-- Message Type -->

577 <dcat:keyword>PaneModel</dcat:keyword>

578 <!-- Model Dependency-->

579 <prov:wasInfluencedBy rdf:resource="urn:uuid:f0063d01-1dac-46f0-91a4-2b7479991173" />

580 <!--Model revision -->

581 <prov:wasRevisionOf rdf:resource="urn:uuid:8341cd19-779b-4a84-bafb-06b8bb56f767" />

582 <!-- Modeling Authority -->

583 <prov:wasAttributedTo rdf:resource="urn:eic:10X1001A1001A094"/>

584 <!-- Modeling Region -->

585 <prov:atLocation rdf:resource="urn:eic:10YBE-----2"/>

```

586     <!-- Status -->
587
588     ... <euvoc:status rdf:resource="http://entsoe.eu/StatusType#Validated"/>
589     <!-- License -->
590     ... <dct:license>http://publications.europa.eu/resource/authority/licence/EUPL_1_2</dct:license>
591     <!-- Process Type -->
592     <eumd:processType rdf:resource="urn:entsoe.eu:ProcessTypeList#CSA"/>
593     <!-- Type -->
594     ....<dct:type>dataset</dct:type>
595     <!-- TimeFrame -->
596     <dct:accrualPeriodicity rdf:resource="urn:entsoe.eu:wgedi:TimeFrameList#Y-1"/>
597     <!-- Modelling Authority of the originator of the model -->
598     <dct:creator>urn:eic:10X1001A1001A094</dct:creator>
599     <!-- Confidentiality for Security Plan -->
600     <dct:accessRights rdf:resource="http://entsoe.eu/MVS/2016/Confidentialyt/OPDE_Secret"/>
601     <!--Service Location -->
602     ... <eumd:serviceLocation rdf:resource="urn:eic:10Y1001A1001A94A" />
603     </md:FullModel>
604

```

605 **A.3 Contingency**

```

606     <csa:OrdinaryContingency rdf:ID="_b2a2dbfa-6eac-4ca6-a31b-6295991bc08b">
607     <cim:IdentifiedObject.name>CO1</cim:IdentifiedObject.name>
608     <cim:IdentifiedObject.mRID>b2a2dbfa-6eac-4ca6-a31b-6295991bc08b</cim:IdentifiedObject.mRID>
609     <cim:Contingency.mustStudy>true</cim:Contingency.mustStudy>
610     <csa:Contingency.probability>99</csa:Contingency.probability>
611     <csa:Contingency.StudiedInRegion rdf:resource="#urn:entsoe:10Y1001C--00059P" />
612     <csa:Contingency.StudiedInRegion rdf:resource="#urn:entsoe:10Y1001C--000239" />
613     <csa:Contingency.RemedialAction rdf:resource="#_64ec4c52-5e70-4e5d-acb7-57a6c06dcf07" />
614     <csa:Contingency.RemedialAction rdf:resource="#_81b9b844-7e98-44ce-8b06-fdf6a631332d" />
615     <csa:Contingency.AssessedElement rdf:resource="#_fd1919e8-b8f9-41d6-870e-785700665e4c" />
616     <csa:Contingency.AssessedElement rdf:resource="#_73bab97c-63a0-4230-8014-cb8e27ad7ffd" />
617     <csa:Contingency.ContingencyOwner rdf:resource="#urn:entsoe:10X1001A1001A094" />
618     </csa:OrdinaryContingency>
619

```

```
620 <cim:ContingencyEquipment rdf:ID="_55095a13-874b-4d00-aa41-7ff6c6ece684">
621   <cim:IdentifiedObject.name>CE1</cim:IdentifiedObject.name>
622   <cim:IdentifiedObject.mRID>55095a13-874b-4d00-aa41-7ff6c6ece684</cim:IdentifiedObject.mRID>
623   <cim:ContingencyEquipment.contingencyStatus
624   rdf:resource="http://iec.ch/TC57/CIM100#ContingencyEquipmentStatusKind.outOfService" />
625   <cim:ContingencyEquipment.Equipment rdf:resource="#_e3cc4a25-f92e-45d2-aaa1-197c4e1a7983" />
626   <cim:ContingencyElement.Contingency rdf:resource="#_b2a2dbfa-6eac-4ca6-a31b-6295991bc08b" />
627 </cim:ContingencyEquipment>
628
```