



European Network of
Transmission System Operators
for Electricity

GENERATION AND LOAD SHIFT KEYS (GLSK) PROFILE SPECIFICATION

2022-02-16

SOC APPROVED
VERSION 1.0

1 Copyright notice:

2 **Copyright © ENTSO-E. All Rights Reserved.**

3 This document and its whole translations may be copied and furnished to others, and derivative
4 works that comment on or otherwise explain it or assist in its implementation may be prepared,
5 copied, published and distributed, in whole or in part, without restriction of any kind, provided
6 that the above copyright notice and this paragraph are included on all such copies and
7 derivative works. However, this document itself may not be modified in any way, except for
8 literal and whole translation into languages other than English and under all circumstances, the
9 copyright notice or references to ENTSO-E may not be removed.

10 This document and the information contained herein is provided on an "as is" basis.

11 **ENTSO-E DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT**
12 **LIMITED TO ANY WARRANTY THAT THE USE OF THE INFORMATION HEREIN WILL NOT**
13 **INFRINGE ANY RIGHTS OR ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR**
14 **FITNESS FOR A PARTICULAR PURPOSE.**

15 **This document is maintained by the ENTSO-E CIM EG. Comments or remarks are to be**
16 **provided at cim@entsoe.eu**

17 **NOTE CONCERNING WORDING USED IN THIS DOCUMENT**

18 The force of the following words is modified by the requirement level of the document in which
19 they are used.

- 20 • **SHALL:** This word, or the terms "REQUIRED" or "MUST", means that the definition is an
21 absolute requirement of the specification.
- 22 • **SHALL NOT:** This phrase, or the phrase "MUST NOT", means that the definition is an
23 absolute prohibition of the specification.
- 24 • **SHOULD:** This word, or the adjective "RECOMMENDED", means that there may exist valid
25 reasons in particular circumstances to ignore a particular item, but the full implications must
26 be understood and carefully weighed before choosing a different course.
- 27 • **SHOULD NOT:** This phrase, or the phrase "NOT RECOMMENDED", means that there may
28 exist valid reasons in particular circumstances when the particular behaviour is acceptable
29 or even useful, but the full implications should be understood and the case carefully weighed
30 before implementing any behaviour described with this label.
- 31 • **MAY:** This word, or the adjective "OPTIONAL", means that an item is truly optional.

32

33

Revision History

Version	Release	Date	Paragraph	Comments
0	1	2021-10-12		For CIM EG review
1	0	2022-02-16		Approved by SOC.

34	CONTENTS		
35	Copyright notice:.....		2
36	Revision History.....		3
37	CONTENTS		4
38	1 Introduction		7
39	2 Application profile specification		7
40	2.1 Version information		7
41	2.2 Constraints naming convention		7
42	2.3 Profile constraints		8
43	2.4 Metadata.....		10
44	2.4.1 Constraints		10
45	2.4.2 Reference metadata		10
46	3 Detailed Profile Specification - GLSK schedule.....		10
47	3.1 General.....		10
48	3.2 (NC,Description) ScheduleResource		12
49	3.3 (abstract) BasicIntervalSchedule		13
50	3.4 (NC,Description) BlockEnergyOrder		13
51	3.5 (abstract) EnergyConnection.....		14
52	3.6 (abstract) ConductingEquipment		14
53	3.7 (Description) EnergyConsumer		14
54	3.8 (NC,Description) EnergyGroup.....		15
55	3.9 (abstract) Equipment.....		15
56	3.10 (Description) GeneratingUnit.....		15
57	3.11 (NC) GLSKSchedule		16
58	3.12 (Description) HydroPump		16
59	3.13 (abstract) IdentifiedObject root class		17
60	3.14 IrregularTimePoint root class		17
61	3.15 (abstract) IrregularIntervalSchedule		18
62	3.16 (Description) PowerElectronicsUnit		18
63	3.17 (abstract) PowerSystemResource		18
64	3.18 Date primitive.....		19
65	3.19 DateTime primitive		19
66	3.20 Float primitive		19
67	3.21 String primitive.....		19
68	3.22 Seconds datatype		19
69	3.23 UnitMultiplier enumeration		19
70	3.24 UnitSymbol enumeration		20
71	4 Detailed Profile Specification - GLSK.....		26
72	4.1 General.....		26
73	4.2 (Description) EnergyConsumer root class		26
74	4.3 (Description) HydroPump root class		26
75	4.4 (NC,Description) BlockEnergyOrder root class		26
76	4.5 (NC,Description) EnergyGroup root class.....		27
77	4.6 (Description) GeneratingUnit root class.....		27

78	4.7	(Description) PowerElectronicsUnit root class	27
79	4.8	(NC,Description) ScheduleResource root class	27
80	4.9	Date primitive.....	27
81	4.10	DateTime primitive	27
82	4.11	Float primitive	28
83	4.12	String primitive.....	28
84	Annex A (informative): Sample data		29
85	A.1	General.....	29
86	A.2	Sample instance data.....	29

87

88 List of figures

89	Figure 1 – Class diagram GLSKScheduleProfile::GLSKScheduleProfile	11
90	Figure 2 – Class diagram GLSKScheduleProfile::Core	12
91	Figure 3 – Class diagram GLSKProfile::GLSK.....	26

92

93 List of tables

94	Table 1 – Attributes of GLSKScheduleProfile::ScheduleResource	13
95	Table 2 – Association ends of GLSKScheduleProfile::ScheduleResource with other	
96	classes	13
97	Table 3 – Attributes of GLSKScheduleProfile::BasicIntervalSchedule.....	13
98	Table 4 – Attributes of GLSKScheduleProfile::BlockEnergyOrder	13
99	Table 5 – Association ends of GLSKScheduleProfile::BlockEnergyOrder with other	
100	classes	14
101	Table 6 – Attributes of GLSKScheduleProfile::EnergyConnection.....	14
102	Table 7 – Attributes of GLSKScheduleProfile::ConductingEquipment	14
103	Table 8 – Attributes of GLSKScheduleProfile::EnergyConsumer	14
104	Table 9 – Association ends of GLSKScheduleProfile::EnergyConsumer with other	
105	classes	15
106	Table 10 – Attributes of GLSKScheduleProfile::EnergyGroup.....	15
107	Table 11 – Association ends of GLSKScheduleProfile::EnergyGroup with other classes	15
108	Table 12 – Attributes of GLSKScheduleProfile::Equipment.....	15
109	Table 13 – Attributes of GLSKScheduleProfile::GeneratingUnit.....	16
110	Table 14 – Association ends of GLSKScheduleProfile::GeneratingUnit with other	
111	classes	16
112	Table 15 – Attributes of GLSKScheduleProfile::GLSKSchedule.....	16
113	Table 16 – Attributes of GLSKScheduleProfile::HydroPump	16
114	Table 17 – Association ends of GLSKScheduleProfile::HydroPump with other classes	17
115	Table 18 – Attributes of GLSKScheduleProfile::IdentifiedObject.....	17
116	Table 19 – Attributes of GLSKScheduleProfile::IrregularTimePoint	17
117	Table 20 – Association ends of GLSKScheduleProfile::IrregularTimePoint with other	
118	classes	17

119	Table 21 – Attributes of GLSKScheduleProfile::IrregularIntervalSchedule	18
120	Table 22 – Attributes of GLSKScheduleProfile::PowerElectronicsUnit	18
121	Table 23 – Association ends of GLSKScheduleProfile::PowerElectronicsUnit with other	
122	classes	18
123	Table 24 – Attributes of GLSKScheduleProfile::PowerSystemResource	18
124	Table 25 – Attributes of GLSKScheduleProfile::Seconds	19
125	Table 26 – Literals of GLSKScheduleProfile::UnitMultiplier	20
126	Table 27 – Literals of GLSKScheduleProfile::UnitSymbol	21
127	Table 28 – Attributes of GLSKProfile::EnergyConsumer	26
128	Table 29 – Attributes of GLSKProfile::HydroPump	26
129	Table 30 – Attributes of GLSKProfile::BlockEnergyOrder	26
130	Table 31 – Attributes of GLSKProfile::EnergyGroup	27
131	Table 32 – Attributes of GLSKProfile::GeneratingUnit	27
132	Table 33 – Attributes of GLSKProfile::PowerElectronicsUnit	27
133	Table 34 – Attributes of GLSKProfile::ScheduleResource	27
134		

135 1 Introduction

136 The generation and load shift keys (GLSK) profile enables and exchange of GLSK. There are
137 two variants of the profile, an exchange of GLSK in the form of schedules and an exchange of
138 the GLSK per MTU.

139 2 Application profile specification

140 2.1 Version information

141 The content is generated from UML model file CGMES30v25_501-20v01_HeaderMetaData-
142 10v08_NC20v70.eap.

143 This edition is based on the IEC 61970 UML version 'IEC61970CIM17v40', dated '2020-08-24'.

144 GLSK – MTU way of exchange

- 145 - Title: GLSK Vocabulary
- 146 - Keyword: GLSK
- 147 - Description: This vocabulary is describing the GLSK profile.
- 148 - Version IRI: <http://entsoe.eu/ns/CIM/GLSK-EU/1.0>
- 149 - Version info: 1.0.0
- 150 - Prior version:
- 151 - Conforms to: urn:iso:std:iec:61970-600-2:ed-1|urn:iso:std:iec:61970-301:ed-7:amd1|file://iec61970cim17v40_iec61968cim13v13a_iec62325cim03v17a.eapurn:iso:std:iec:61970-401:draft:ed-1|urn:iso:std:iec:61970-501:draft:ed-2|file://CGMES-30v25_501-20v01.eap
- 152
- 153
- 154
- 155 - Identifier: <urn:uuid:5f727c5c-b49f-47be-b750-a00fefb7e806>

156 GLSK – schedule way of exchange

- 157 - Title: GLSK schedule vocabulary
- 158 - Keyword: GLSKS
- 159 - Description: This vocabulary is describing the GLSK schedule profile.
- 160 - Version IRI: <http://entsoe.eu/ns/CIM/GLSKSchedule-EU/1.0>
- 161 - Version info: 1.0.0
- 162 - Prior version:
- 163 - Conforms to: urn:iso:std:iec:61970-600-2:ed-1|urn:iso:std:iec:61970-301:ed-7:amd1|file://iec61970cim17v40_iec61968cim13v13a_iec62325cim03v17a.eapurn:iso:std:iec:61970-401:draft:ed-1|urn:iso:std:iec:61970-501:draft:ed-2|file://CGMES-30v25_501-20v01.eap
- 164
- 165
- 166
- 167 - Identifier: <urn:uuid:af884936-ea95-416b-b4c9-1214caa68658>

168 2.2 Constraints naming convention

169 The naming of the rules shall not be used for machine processing. The rule names are just a
170 string. The naming convention of the constraints is as follows.

171 “{rule.Type}:{rule.Standard}:{rule.Profile}:{rule.Property}:{rule.Name}”

172 where

173 rule.Type: C – for constraint; R – for requirement

174 rule.Standard: the number of the standard e.g. 301 for 61970-301, 456 for 61970-456, 13 for
175 61968-13. 61970-600 specific constraints refer to 600 although they are related to one or
176 combination of the 61970-450 series profiles. For NC profiles, NC is used.

177 rule.Profile: the abbreviation of the profile, e.g. TP for Topology profile. If set to “ALL” the
178 constraint is applicable to all IEC 61970-600 profiles.

179 rule.Property: for UML classes, the name of the class, for attributes and associations, the name
180 of the class and attribute or association end, e.g. EnergyConsumer, IdentifiedObject.name, etc.
181 If set to “NA” the property is not applicable to a specific UML element.

182 rule.Name: the name of the rule. It is unique for the same property.

183 Example: C:600:ALL:IdentifiedObject.name:stringLength

184 2.3 Profile constraints

185 This clause defines requirements and constraints that shall be fulfilled by applications that
186 conform to this document.

187 This document is the master for rules and constraints tagged "NC". For the sake of self-
188 containment, the list below also includes a copy of the relevant rules from IEC 61970-452,
189 tagged "452".

- 190 • C:452:ALL:NA:datatypes

191 According to 61970-501, datatypes are not exchanged in the instance data. The
192 UnitMultiplier is 1 in cases none value is specified in the profile.

- 193 • R:452:ALL:NA:exchange

194 Optional and required attributes and associations must be imported and exported if they
195 are in the model file prior to import.

- 196 • R:452:ALL:NA:exchange1

197 If an optional attribute does not exist in the imported file, it does not have to be exported
198 in case exactly the same data set is exported, i.e. the tool is not obliged to automatically
199 provide this attribute. If the export is resulting from an action by the user performed after
200 the import, e.g. data processing or model update the export can contain optional
201 attributes.

- 202 • R:452:ALL:NA:exchange2

203 In most of the profiles the selection of optional and required attributes is made so as to
204 ensure a minimum set of required attributes without which the exchange does not fulfil
205 its basic purpose. Business processes governing different exchanges can require
206 mandatory exchange of certain optional attributes or associations. Optional and required
207 attributes and associations shall therefore be supported by applications which claim
208 conformance with certain functionalities of the IEC 61970-452. This provides flexibility
209 for the business processes to adapt to different business requirements and base the
210 exchanges on IEC 61970-452 compliant applications.

- 211 • R:452:ALL:NA:exchange3

- 212 An exporter may, at his or her discretion, produce a serialization containing additional
213 class data described by the CIM Schema but not required by this document provided
214 these data adhere to the conventions established in Clause 5.
- 215 • R:452:ALL:NA:exchange4
- 216 From the standpoint of the model import used by a data recipient, the document
217 describes a subset of the CIM that importing software shall be able to interpret in order
218 to import exported models. Data providers are free to exceed the minimum requirements
219 described herein as long as their resulting data files are compliant with the CIM Schema
220 and the conventions established in Clause 5. The document, therefore, describes
221 additional classes and class data that, although not required, exporters will, in all
222 likelihood, choose to include in their data files. The additional classes and data are
223 labelled as required (cardinality 1..1) or as optional (cardinality 0..1) to distinguish them
224 from their required counterparts. Please note, however, that data importers could
225 potentially receive data containing instances of any and all classes described by the
226 CIM Schema.
- 227 • R:452:ALL:NA:cardinality
- 228 The cardinality defined in the CIM model shall be followed, unless a more restrictive
229 cardinality is explicitly defined in this document. For instance, the cardinality on the
230 association between VoltageLevel and BaseVoltage indicates that a VoltageLevel shall
231 be associated with one and only one BaseVoltage, but a BaseVoltage can be associated
232 with zero to many VoltageLevels.
- 233 • R:452:ALL:NA:associations
- 234 Associations between classes referenced in this document and classes not referenced
235 here are not required regardless of cardinality.
- 236 • R:452:ALL:IdentifiedObject.name:rule
- 237 The attribute “name” inherited by many classes from the abstract class IdentifiedObject
238 is not required to be unique. It must be a human readable identifier without additional
239 embedded information that would need to be parsed. The attribute is used for purposes
240 such as User Interface and data exchange debugging. The MRID defined in the data
241 exchange format is the only unique and persistent identifier used for this data exchange.
242 The attribute IdentifiedObject.name is, however, always required for CoreEquipment
243 profile and Short Circuit profile.
- 244 • R:452:ALL:IdentifiedObject.description:rule
- 245 The attribute “description” inherited by many classes from the abstract class
246 IdentifiedObject must contain human readable text without additional embedded
247 information that would need to be parsed.
- 248 • R:452:ALL:NA:uniqueIdentifier
- 249 All IdentifiedObject-s shall have a persistent and globally unique identifier (Master
250 Resource Identifier - mRID).
- 251 • R:452:ALL:NA:unitMultiplier
- 252 For exchange of attributes defined using CIM Data Types (ActivePower, Susceptance,
253 etc.) a unit multiplier of 1 is used if the UnitMultiplier specified in this document is “none”.
- 254 • C:452:ALL:IdentifiedObject.name:stringLength

255 The string IdentifiedObject.name has a maximum of 128 characters.

- 256 • C:452:ALL:IdentifiedObject.description:stringLength

257 The string IdentifiedObject.description is maximum 256 characters.

- 258 • C:452:ALL:NA:float

259 An attribute that is defined as float (e.g. has a type Float or a type which is a Datatype
260 with .value attribute of type Float) shall support ISO/IEC 60559:2020 for floating-point
261 arithmetic using single precision floating point. A single precision float supports 7
262 significant digits where the significant digits are described as an integer, or a decimal
263 number with 6 decimal digits. Two float values are equal when the significant with 7
264 digits are identical, e.g. 1234567 is equal 1.234567E6 and so are 1.2345678 and
265 1.234567E0.

266

267 2.4 Metadata

268 ENTSO-E agreed to extend the header and metadata definitions by IEC 61970-552 Ed2. This
269 new header definitions rely on W3C recommendations which are used worldwide and are
270 positively recognised by the European Commission. The new definitions of the header mainly
271 use Provenance ontology (PROV-O), Time Ontology and Data Catalog Vocabulary (DCAT). The
272 global new header applicable for this profile is included in the metadata and document header
273 specification document.

274 The header vocabulary contains all attributes defined in IEC 61970-552. This is done only for
275 the purpose of having one vocabulary for header and to ensure transition for data exchanges
276 that are using IEC 61970-552:2016 header. This profile does not use IEC 61970-552:2016
277 header attributes and relies only on the extended attributes.

278 2.4.1 Constraints

279 The identification of the constraints related to the metadata follows the same convention for
280 naming of the constraints as for profile constraints.

- 281 • R:NC:ALL:wasAttributedTo:usage

282 The prov:wasAttributedTo should normally be the “X” EIC code of the actor (prov:Agent).

283


284 2.4.2 Reference metadata

285 The header defined for this profile requires availability of a set of reference metadata. For
286 instance, the attribute prov:wasGeneratedBy requires a reference to an activity which produced
287 the model or the related process. The activities are defined as reference metadata and their
288 identifiers are referenced from the header to enable the receiving entity to retrieve the “static”
289 (reference) information that is not modified frequently. This approach imposes a requirement
290 that both the sending entity and the receiving entity have access to a unique version of the
291 reference metadata. Therefore, each business process shall define which reference metadata
292 is used and where it is located.

293 3 Detailed Profile Specification - GLSK schedule

294 3.1 General

295 This package contains the generation and load shift keys (GLSK) schedule profile.

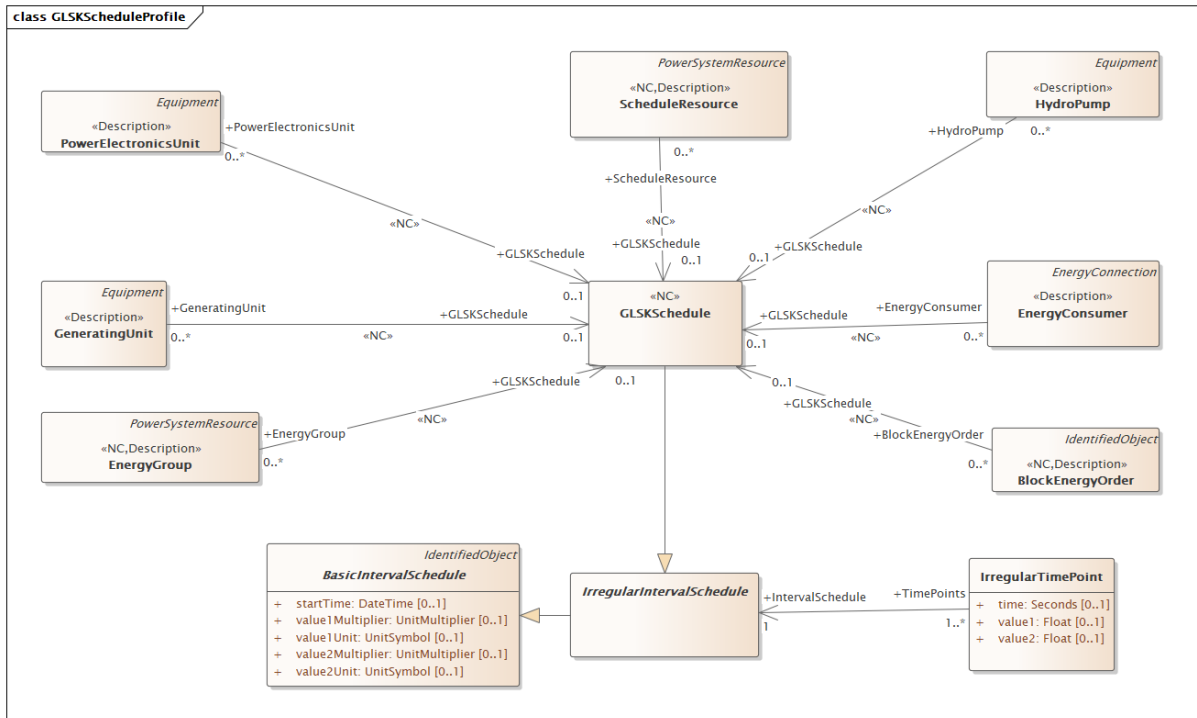


296

297

Figure 1 – Class diagram GLSKScheduleProfile::GLSKScheduleProfile

298

Figure 1: The diagram shows generation and load shift keys related classes.

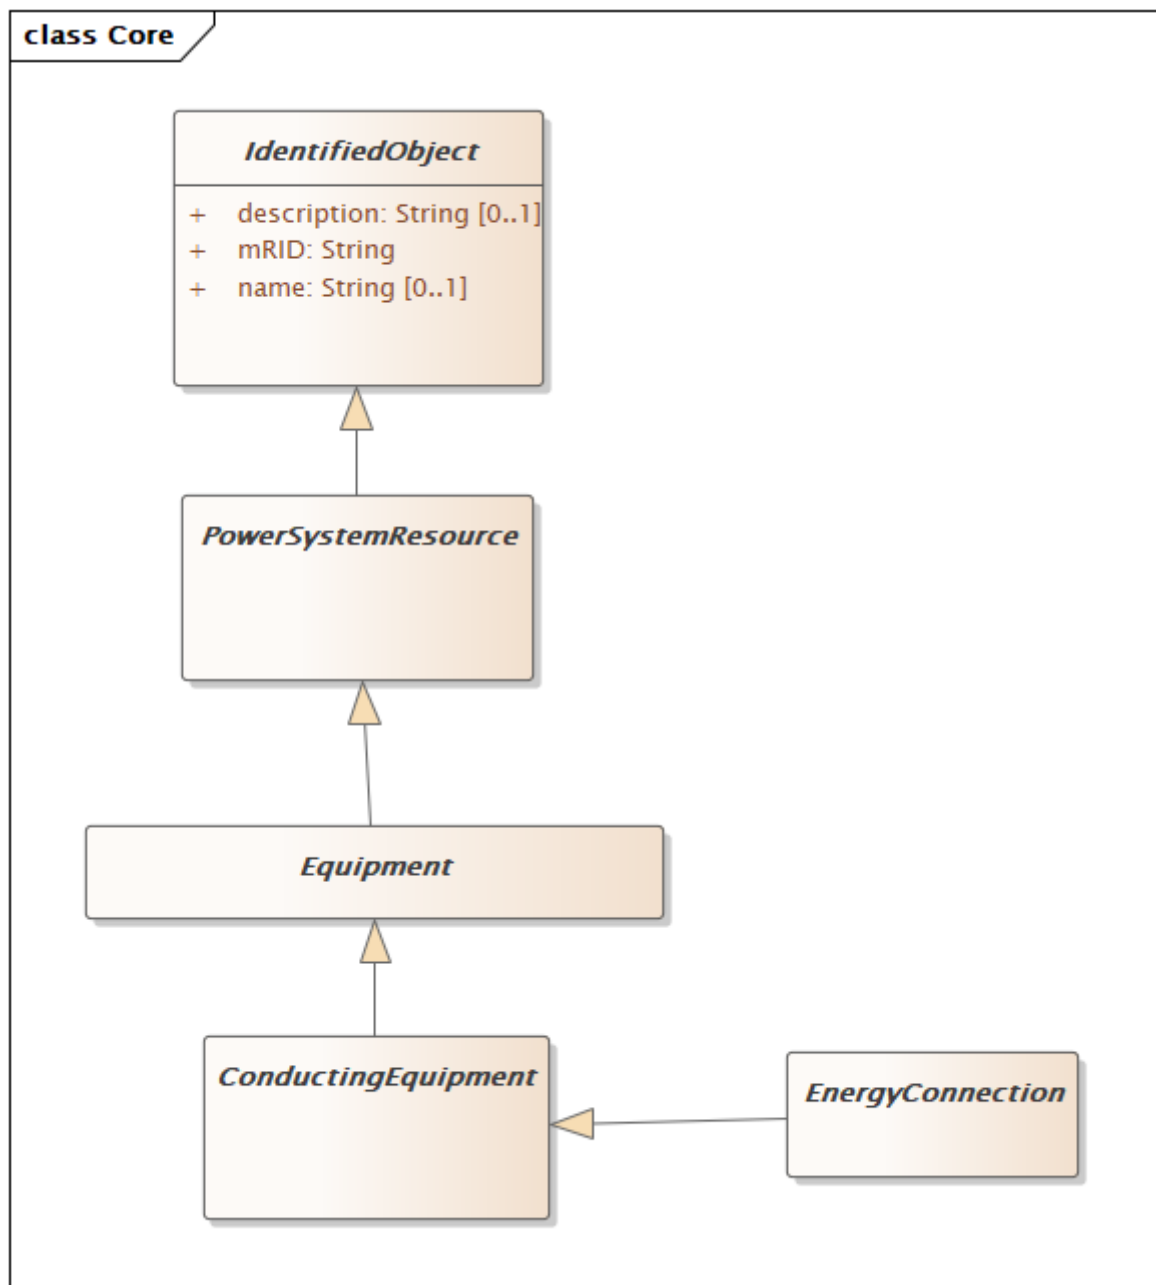

299

300

Figure 2 – Class diagram GLSKScheduleProfile::Core

301 Figure 2: The diagram shows classes from Base CIM used in the availability plan profile.

302 **3.2 (NC,Description) ScheduleResource**

303 Inheritance path = [PowerSystemResource](#) : [IdentifiedObject](#)

304 A schedule resource is a market-based method for handling participation of small units,
 305 particularly located on the lower voltage level that is controlled by a Distributed System
 306 Operator (DSO). It is a collection of units that can operate in the market by providing bids, offers
 307 and a resulting committed operational schedule for the collection.

308 Table 1 shows all attributes of ScheduleResource.

309

Table 1 – Attributes of GLSKScheduleProfile::ScheduleResource

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

310

311

Table 2 shows all association ends of ScheduleResource with other classes.

312

Table 2 – Association ends of GLSKScheduleProfile::ScheduleResource with other classes

313

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for a schedule resource.

314

3.3 (abstract) BasicIntervalSchedule

Inheritance path = [IdentifiedObject](#)

Schedule of values at points in time.

Table 3 shows all attributes of BasicIntervalSchedule.

319

Table 3 – Attributes of GLSKScheduleProfile::BasicIntervalSchedule

name	mult	type	description
startTime	0..1	DateTime	The time for the first time point. The value can be a time of day, not a specific date.
value1Multiplier	0..1	UnitMultiplier	Multiplier for value1.
value1Unit	0..1	UnitSymbol	Value1 units of measure.
value2Multiplier	0..1	UnitMultiplier	Multiplier for value2.
value2Unit	0..1	UnitSymbol	Value2 units of measure.
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

320

3.4 (NC,Description) BlockEnergyOrder

Inheritance path = [IdentifiedObject](#)

The order given by a block dispatch instruction that are distributing the energy over the energy components.

Table 4 shows all attributes of BlockEnergyOrder.

326

Table 4 – Attributes of GLSKScheduleProfile::BlockEnergyOrder

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

327

328

Table 5 shows all association ends of BlockEnergyOrder with other classes.

329 **Table 5 – Association ends of GLSKScheduleProfile::BlockEnergyOrder with other**
330 **classes**

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for a BlockEnergyOrder.

331
332 **3.5 (abstract) EnergyConnection**
333 Inheritance path = [ConductingEquipment](#) : [Equipment](#) : [PowerSystemResource](#) :
334 [IdentifiedObject](#)
335 A connection of energy generation or consumption on the power system model.
336 Table 6 shows all attributes of EnergyConnection.

337 **Table 6 – Attributes of GLSKScheduleProfile::EnergyConnection**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

338
339 **3.6 (abstract) ConductingEquipment**
340 Inheritance path = [Equipment](#) : [PowerSystemResource](#) : [IdentifiedObject](#)
341 The parts of the AC power system that are designed to carry current or that are conductively
342 connected through terminals.
343 Table 7 shows all attributes of ConductingEquipment.

344 **Table 7 – Attributes of GLSKScheduleProfile::ConductingEquipment**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

345
346 **3.7 (Description) EnergyConsumer**
347 Inheritance path = [EnergyConnection](#) : [ConductingEquipment](#) : [Equipment](#) :
348 [PowerSystemResource](#) : [IdentifiedObject](#)
349 Generic user of energy - a point of consumption on the power system model.
350 EnergyConsumer.pfixed, .qfixed, .pfixedPct and .qfixedPct have meaning only if there is no
351 LoadResponseCharacteristic associated with EnergyConsumer or if
352 LoadResponseCharacteristic.exponentModel is set to False.
353 Table 8 shows all attributes of EnergyConsumer.

354 **Table 8 – Attributes of GLSKScheduleProfile::EnergyConsumer**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

355
356 Table 9 shows all association ends of EnergyConsumer with other classes.

357 **Table 9 – Association ends of GLSKScheduleProfile::EnergyConsumer with other**
358 **classes**

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for an Energy Consumer.

359

360 **3.8 (NC,Description) EnergyGroup**

361 Inheritance path = [PowerSystemResource](#) : [IdentifiedObject](#)

362 A group of energy consumers and/or energy producers used for forecasting and/or scheduling
363 slack distribution and area interchange control.

364 Table 10 shows all attributes of EnergyGroup.

365 **Table 10 – Attributes of GLSKScheduleProfile::EnergyGroup**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

366

367 Table 11 shows all association ends of EnergyGroup with other classes.

368 **Table 11 – Association ends of GLSKScheduleProfile::EnergyGroup with other classes**

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for an EnergyGroup.

369

370 **3.9 (abstract) Equipment**

371 Inheritance path = [PowerSystemResource](#) : [IdentifiedObject](#)

372 The parts of a power system that are physical devices, electronic or mechanical.

373 Table 12 shows all attributes of Equipment.

374 **Table 12 – Attributes of GLSKScheduleProfile::Equipment**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

375

376 **3.10 (Description) GeneratingUnit**

377 Inheritance path = [Equipment](#) : [PowerSystemResource](#) : [IdentifiedObject](#)

378 A single or set of synchronous machines for converting mechanical power into alternating-
379 current power. For example, individual machines within a set may be defined for scheduling
380 purposes while a single control signal is derived for the set. In this case there would be a
381 GeneratingUnit for each member of the set and an additional GeneratingUnit corresponding to
382 the set.

383 Table 13 shows all attributes of GeneratingUnit.

384

Table 13 – Attributes of GLSKScheduleProfile::GeneratingUnit

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

385

386

Table 14 shows all association ends of GeneratingUnit with other classes.

387

Table 14 – Association ends of GLSKScheduleProfile::GeneratingUnit with other classes

388

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for a Generating Unit.

389

3.11 (NC) GLSKSchedule

390

Inheritance path = [IrregularIntervalSchedule](#) : [BasicIntervalSchedule](#) : [IdentifiedObject](#)

391

The schedule for Generation and Load Shift Keys (GLSK).

392

Table 15 shows all attributes of GLSKSchedule.

393

Table 15 – Attributes of GLSKScheduleProfile::GLSKSchedule

394

name	mult	type	description
startTime	0..1	DateTime	inherited from: BasicIntervalSchedule
value1Multiplier	0..1	UnitMultiplier	inherited from: BasicIntervalSchedule
value1Unit	0..1	UnitSymbol	inherited from: BasicIntervalSchedule
value2Multiplier	0..1	UnitMultiplier	inherited from: BasicIntervalSchedule
value2Unit	0..1	UnitSymbol	inherited from: BasicIntervalSchedule
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

395

3.12 (Description) HydroPump

396

Inheritance path = [Equipment](#) : [PowerSystemResource](#) : [IdentifiedObject](#)

397

A synchronous motor-driven pump, typically associated with a pumped storage plant.

398

Table 16 shows all attributes of HydroPump.

399

Table 16 – Attributes of GLSKScheduleProfile::HydroPump

400

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

401

402

Table 17 shows all association ends of HydroPump with other classes.

403 **Table 17 – Association ends of GLSKScheduleProfile::HydroPump with other classes**

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for a Hydro Pump.

404

405 **3.13 (abstract) IdentifiedObject root class**

406 This is a root class to provide common identification for all classes needing identification and
407 naming attributes.

408 Table 18 shows all attributes of IdentifiedObject.

409 **Table 18 – Attributes of GLSKScheduleProfile::IdentifiedObject**

name	mult	type	description
description	0..1	String	The description is a free human readable text describing or naming the object. It may be non unique and may not correlate to a naming hierarchy.
mRID	1..1	String	Master resource identifier issued by a model authority. The mRID is unique within an exchange context. Global uniqueness is easily achieved by using a UUID, as specified in RFC 4122, for the mRID. The use of UUID is strongly recommended. For CIMXML data files in RDF syntax conforming to IEC 61970-552, the mRID is mapped to rdf:ID or rdf:about attributes that identify CIM object elements.
name	0..1	String	The name is any free human readable and possibly non unique text naming the object.

410

411 **3.14 IrregularTimePoint root class**

412 TimePoints for a schedule where the time between the points varies.

413 Table 19 shows all attributes of IrregularTimePoint.

414 **Table 19 – Attributes of GLSKScheduleProfile::IrregularTimePoint**

name	mult	type	description
time	0..1	Seconds	The time is relative to the schedule starting time.
value1	0..1	Float	The first value at the time. The meaning of the value is defined by the derived type of the associated schedule.
value2	0..1	Float	The second value at the time. The meaning of the value is defined by the derived type of the associated schedule.

415

416 Table 20 shows all association ends of IrregularTimePoint with other classes.

417 **Table 20 – Association ends of GLSKScheduleProfile::IrregularTimePoint with other**
418 **classes**

mult from	name	mult to	type	description
1..*	IntervalSchedule	1..1	IrregularIntervalSchedule	An IrregularTimePoint belongs to an IrregularIntervalSchedule.

419

420 **3.15 (abstract) IrregularIntervalSchedule**

421 Inheritance path = [BasicIntervalSchedule](#) : [IdentifiedObject](#)

422 The schedule has time points where the time between them varies.

423 Table 21 shows all attributes of IrregularIntervalSchedule.

424 **Table 21 – Attributes of GLSKScheduleProfile::IrregularIntervalSchedule**

name	mult	type	description
startTime	0..1	DateTime	inherited from: BasicIntervalSchedule
value1Multiplier	0..1	UnitMultiplier	inherited from: BasicIntervalSchedule
value1Unit	0..1	UnitSymbol	inherited from: BasicIntervalSchedule
value2Multiplier	0..1	UnitMultiplier	inherited from: BasicIntervalSchedule
value2Unit	0..1	UnitSymbol	inherited from: BasicIntervalSchedule
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

425

426 **3.16 (Description) PowerElectronicsUnit**

427 Inheritance path = [Equipment](#) : [PowerSystemResource](#) : [IdentifiedObject](#)

428 A generating unit or battery or aggregation that connects to the AC network using power electronics rather than rotating machines.

429 Table 22 shows all attributes of PowerElectronicsUnit.

431 **Table 22 – Attributes of GLSKScheduleProfile::PowerElectronicsUnit**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

432

433 Table 23 shows all association ends of PowerElectronicsUnit with other classes.

434 **Table 23 – Association ends of GLSKScheduleProfile::PowerElectronicsUnit with other classes**

mult from	name	mult to	type	description
0..*	GLSKSchedule	0..1	GLSKSchedule	(NC) The GLSK schedule for a Power Electronics Unit.

436

437 **3.17 (abstract) PowerSystemResource**

438 Inheritance path = [IdentifiedObject](#)

439 A power system resource (PSR) can be an item of equipment such as a switch, an equipment container containing many individual items of equipment such as a substation, or an organisational entity such as sub-control area. Power system resources can have measurements associated.

443 Table 24 shows all attributes of PowerSystemResource.

444 **Table 24 – Attributes of GLSKScheduleProfile::PowerSystemResource**

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject

name	mult	type	description
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

445

446 **3.18 Date primitive**

447 Date as "yyyy-mm-dd", which conforms with ISO 8601. UTC time zone is specified as "yyyy-
448 mm-ddZ". A local timezone relative UTC is specified as "yyyy-mm-dd(+/-)hh:mm".

449 **3.19 DateTime primitive**

450 Date and time as "yyyy-mm-ddThh:mm:ss.sss", which conforms with ISO 8601. UTC time zone
451 is specified as "yyyy-mm-ddThh:mm:ss.sssZ". A local timezone relative UTC is specified as
452 "yyyy-mm-ddThh:mm:ss.sss-hh:mm". The second component (shown here as "ss.sss") could
453 have any number of digits in its fractional part to allow any kind of precision beyond seconds.

454 **3.20 Float primitive**

455 A floating point number. The range is unspecified and not limited.

456 **3.21 String primitive**

457 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
458 length is unspecified and unlimited.

459 **3.22 Seconds datatype**

460 Time, in seconds.

461 Table 25 shows all attributes of Seconds.

462

Table 25 – Attributes of GLSKScheduleProfile::Seconds

name	mult	type	description
value	0..1	Float	Time, in seconds
unit	0..1	UnitSymbol	(const=s)
multiplier	0..1	UnitMultiplier	(const=none)

463

464 **3.23 UnitMultiplier enumeration**

465 The unit multipliers defined for the CIM. When applied to unit symbols, the unit symbol is
466 treated as a derived unit. Regardless of the contents of the unit symbol text, the unit symbol
467 shall be treated as if it were a single-character unit symbol. Unit symbols should not contain
468 multipliers, and it should be left to the multiplier to define the multiple for an entire data type.

469 For example, if a unit symbol is "m2Pers" and the multiplier is "k", then the value is $k(m^{**2}/s)$,
470 and the multiplier applies to the entire final value, not to any individual part of the value. This
471 can be conceptualized by substituting a derived unit symbol for the unit type. If one imagines
472 that the symbol "P" represents the derived unit "m2Pers", then applying the multiplier "k" can
473 be conceptualized simply as "kP".

474 For example, the SI unit for mass is "kg" and not "g". If the unit symbol is defined as "kg", then
475 the multiplier is applied to "kg" as a whole and does not replace the "k" in front of the "g". In
476 this case, the multiplier of "m" would be used with the unit symbol of "kg" to represent one gram.

477 As a text string, this violates the instructions in IEC 80000-1. However, because the unit symbol
478 in CIM is treated as a derived unit instead of as an SI unit, it makes more sense to conceptualize
479 the "kg" as if it were replaced by one of the proposed replacements for the SI mass symbol. If
480 one imagines that the "kg" were replaced by a symbol "P", then it is easier to conceptualize the
481 multiplier "m" as creating the proper unit "mP", and not the forbidden unit "mkg".

482 Table 26 shows all literals of UnitMultiplier.

483

Table 26 – Literals of GLSKScheduleProfile::UnitMultiplier

literal	value	description
y	-24	Yocto 10** ⁻²⁴ .
z	-21	Zepto 10** ⁻²¹ .
a	-18	Atto 10** ⁻¹⁸ .
f	-15	Femto 10** ⁻¹⁵ .
p	-12	Pico 10** ⁻¹² .
n	-9	Nano 10** ⁻⁹ .
micro	-6	Micro 10** ⁻⁶ .
m	-3	Milli 10** ⁻³ .
c	-2	Centi 10** ⁻² .
d	-1	Deci 10** ⁻¹ .
none	0	No multiplier or equivalently multiply by 1.
da	1	Deca 10** ¹ .
h	2	Hecto 10** ² .
k	3	Kilo 10** ³ .
M	6	Mega 10** ⁶ .
G	9	Giga 10** ⁹ .
T	12	Tera 10** ¹² .
P	15	Peta 10** ¹⁵ .
E	18	Exa 10** ¹⁸ .
Z	21	Zetta 10** ²¹ .
Y	24	Yotta 10** ²⁴ .

484

485 3.24 UnitSymbol enumeration

486 The derived units defined for usage in the CIM. In some cases, the derived unit is equal to an
 487 SI unit. Whenever possible, the standard derived symbol is used instead of the formula for the
 488 derived unit. For example, the unit symbol Farad is defined as "F" instead of "CPerV". In cases
 489 where a standard symbol does not exist for a derived unit, the formula for the unit is used as
 490 the unit symbol. For example, density does not have a standard symbol and so it is represented
 491 as "kgPerm3". With the exception of the "kg", which is an SI unit, the unit symbols do not contain
 492 multipliers and therefore represent the base derived unit to which a multiplier can be applied as
 493 a whole.

494 Every unit symbol is treated as an unparseable text as if it were a single-letter symbol. The
 495 meaning of each unit symbol is defined by the accompanying descriptive text and not by the
 496 text contents of the unit symbol.

497 To allow the widest possible range of serializations without requiring special character handling,
 498 several substitutions are made which deviate from the format described in IEC 80000-1. The
 499 division symbol "/" is replaced by the letters "Per". Exponents are written in plain text after the
 500 unit as "m3" instead of being formatted as "m" with a superscript of 3 or introducing a symbol
 501 as in "m³". The degree symbol "°" is replaced with the letters "deg". Any clarification of the
 502 meaning for a substitution is included in the description for the unit symbol.

503 Non-SI units are included in list of unit symbols to allow sources of data to be correctly labelled
 504 with their non-SI units (for example, a GPS sensor that is reporting numbers that represent feet
 505 instead of meters). This allows software to use the unit symbol information correctly convert
 506 and scale the raw data of those sources into SI-based units.

507 The integer values are used for harmonization with IEC 61850.

508 Table 27 shows all literals of UnitSymbol.

509

Table 27 – Literals of GLSKScheduleProfile::UnitSymbol

literal	value	description
none	0	Dimension less quantity, e.g. count, per unit, etc.
m	2	Length in metres.
kg	3	Mass in kilograms. Note: multiplier “k” is included in this unit symbol for compatibility with IEC 61850-7-3.
s	4	Time in seconds.
A	5	Current in amperes.
K	6	Temperature in kelvins.
mol	7	Amount of substance in moles.
cd	8	Luminous intensity in candelas.
deg	9	Plane angle in degrees.
rad	10	Plane angle in radians (m/m).
sr	11	Solid angle in steradians (m ² /m ²).
Gy	21	Absorbed dose in grays (J/kg).
Bq	22	Radioactivity in becquerels (1/s).
degC	23	Relative temperature in degrees Celsius. In the SI unit system the symbol is °C. Electric charge is measured in coulomb that has the unit symbol C. To distinguish degree Celsius from coulomb the symbol used in the UML is degC. The reason for not using °C is that the special character ° is difficult to manage in software.
Sv	24	Dose equivalent in sieverts (J/kg).
F	25	Electric capacitance in farads (C/V).
C	26	Electric charge in coulombs (A·s).
S	27	Conductance in siemens.
H	28	Electric inductance in henrys (Wb/A).
V	29	Electric potential in volts (W/A).
ohm	30	Electric resistance in ohms (V/A).
J	31	Energy in joules (N·m = C·V = W·s).
N	32	Force in newtons (kg·m/s ²).
Hz	33	Frequency in hertz (1/s).
lx	34	Illuminance in lux (lm/m ²).
lm	35	Luminous flux in lumens (cd·sr).
Wb	36	Magnetic flux in webers (V·s).
T	37	Magnetic flux density in teslas (Wb/m ²).
W	38	Real power in watts (J/s). Electrical power may have real and reactive components. The real portion of electrical power (I ² R or VIcos(phi)), is expressed in Watts. See also apparent power and reactive power.
Pa	39	Pressure in pascals (N/m ²). Note: the absolute or relative measurement of pressure is implied with this entry. See below for more explicit forms.
m2	41	Area in square metres (m ²).

literal	value	description
m3	42	Volume in cubic metres (m ³).
mPers	43	Velocity in metres per second (m/s).
mPers2	44	Acceleration in metres per second squared (m/s ²).
m3Pers	45	Volumetric flow rate in cubic metres per second (m ³ /s).
mPerm3	46	Fuel efficiency in metres per cubic metres (m/m ³).
kgm	47	Moment of mass in kilogram metres (kg·m) (first moment of mass). Note: multiplier “k” is included in this unit symbol for compatibility with IEC 61850-7-3.
kgPerm3	48	Density in kilogram/cubic metres (kg/m ³). Note: multiplier “k” is included in this unit symbol for compatibility with IEC 61850-7-3.
m2Pers	49	Viscosity in square metres / second (m ² /s).
WPermK	50	Thermal conductivity in watt/metres kelvin.
JPerK	51	Heat capacity in joules/kelvin.
ppm	52	Concentration in parts per million.
rotPers	53	Rotations per second (1/s). See also Hz (1/s).
radPers	54	Angular velocity in radians per second (rad/s).
WPerm2	55	Heat flux density, irradiance, watts per square metre.
JPerm2	56	Insulation energy density, joules per square metre or watt second per square metre.
SPerm	57	Conductance per length (F/m).
KPers	58	Temperature change rate in kelvins per second.
PaPers	59	Pressure change rate in pascals per second.
JPerkgK	60	Specific heat capacity, specific entropy, joules per kilogram Kelvin.
VA	61	Apparent power in volt amperes. See also real power and reactive power.
VAr	63	Reactive power in volt amperes reactive. The “reactive” or “imaginary” component of electrical power (VIsin(phi)). (See also real power and apparent power). Note: Different meter designs use different methods to arrive at their results. Some meters may compute reactive power as an arithmetic value, while others compute the value vectorially. The data consumer should determine the method in use and the suitability of the measurement for the intended purpose.
cosPhi	65	Power factor, dimensionless. Note 1: This definition of power factor only holds for balanced systems. See the alternative definition under code 153. Note 2 : Beware of differing sign conventions in use between the IEC and EEI. It is assumed that the data consumer understands the type of meter in use and the sign convention in use by the utility.
Vs	66	Volt seconds (Ws/A).

literal	value	description
V2	67	Volt squared (W^2/A^2).
As	68	Ampere seconds (A·s).
A2	69	Amperes squared (A^2).
A2s	70	Ampere squared time in square amperes (A^2s).
VAh	71	Apparent energy in volt ampere hours.
Wh	72	Real energy in watt hours.
VArh	73	Reactive energy in volt ampere reactive hours.
VPerHz	74	Magnetic flux in volt per hertz.
HzPers	75	Rate of change of frequency in hertz per second.
character	76	Number of characters.
charPers	77	Data rate (baud) in characters per second.
kgm2	78	Moment of mass in kilogram square metres ($kg·m^2$) (Second moment of mass, commonly called the moment of inertia). Note: multiplier “k” is included in this unit symbol for compatibility with IEC 61850-7-3.
dB	79	Sound pressure level in decibels. Note: multiplier “d” is included in this unit symbol for compatibility with IEC 61850-7-3.
WPers	81	Ramp rate in watts per second.
IPers	82	Volumetric flow rate in litres per second.
dBm	83	Power level (logarithmic ratio of signal strength , Bel-mW), normalized to 1mW. Note: multiplier “d” is included in this unit symbol for compatibility with IEC 61850-7-3.
h	84	Time in hours, hour = 60 min = 3600 s.
min	85	Time in minutes, minute = 60 s.
Q	100	Quantity power, Q.
Qh	101	Quantity energy, Qh.
ohmm	102	Resistivity, ohm metres, (ρ).
APerm	103	A/m, magnetic field strength, amperes per metre.
V2h	104	Volt-squared hour, volt-squared-hours.
A2h	105	Ampere-squared hour, ampere-squared hour.
Ah	106	Ampere-hours, ampere-hours.
count	111	Amount of substance, Counter value.
ft3	119	Volume, cubic feet.
m3Perh	125	Volumetric flow rate, cubic metres per hour.
gal	128	Volume in gallons, US gallon (1 gal = 231 in ³ = 128 fl ounce).
Btu	132	Energy, British Thermal Units.
l	134	Volume in litres, litre = dm ³ = m ³ /1000.
lPerh	137	Volumetric flow rate, litres per hour.
lPerl	143	Concentration, The ratio of the volume of a solute divided by the volume of the solution. Note: Users may need use a prefix such a ‘ μ ’ to express a quantity such as ‘ $\mu L/L$ ’.


literal	value	description
gPerg	144	Concentration, The ratio of the mass of a solute divided by the mass of the solution. Note: Users may need use a prefix such a 'µ' to express a quantity such as 'µg/g'.
molPerm3	145	Concentration, The amount of substance concentration, (c), the amount of solvent in moles divided by the volume of solution in m ³ .
molPermol	146	Concentration, Molar fraction, the ratio of the molar amount of a solute divided by the molar amount of the solution.
molPerkg	147	Concentration, Molality, the amount of solute in moles and the amount of solvent in kilograms.
sPers	149	Time, Ratio of time. Note: Users may need to supply a prefix such as 'µ' to show rates such as 'µs/s'.
HzPerHz	150	Frequency, rate of frequency change. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mHz/Hz'.
VPerV	151	Voltage, ratio of voltages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mV/V'.
APerA	152	Current, ratio of amperages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mA/A'.
VPerVA	153	Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.
rev	154	Amount of rotation, revolutions.
kat	158	Catalytic activity, katal = mol / s.
JPerkg	165	Specific energy, Joules / kg.
m3Uncompensated	166	Volume, cubic metres, with the value uncompensated for weather effects.
m3Compensated	167	Volume, cubic metres, with the value compensated for weather effects.
WPerW	168	Signal Strength, ratio of power. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mW/W'.
therm	169	Energy, therms.
onePerm	173	Wavenumber, reciprocal metres, (1/m).
m3Perkg	174	Specific volume, cubic metres per kilogram, v.
Pas	175	Dynamic viscosity, pascal seconds.
Nm	176	Moment of force, newton metres.
NPerm	177	Surface tension, newton per metre.
radPers2	178	Angular acceleration, radians per second squared.
JPerm3	181	Energy density, joules per cubic metre.
VPerm	182	Electric field strength, volts per metre.

literal	value	description
CPerm3	183	Electric charge density, coulombs per cubic metre.
CPerm2	184	Surface charge density, coulombs per square metre.
FPerm	185	Permittivity, farads per metre.
HPerm	186	Permeability, henrys per metre.
JPermol	187	Molar energy, joules per mole.
JPermolK	188	Molar entropy, molar heat capacity, joules per mole kelvin.
CPerkg	189	Exposure (x rays), coulombs per kilogram.
GyPers	190	Absorbed dose rate, grays per second.
WPersr	191	Radiant intensity, watts per steradian.
WPerm2sr	192	Radiance, watts per square metre steradian.
katPerm3	193	Catalytic activity concentration, katals per cubic metre.
d	195	Time in days, day = 24 h = 86400 s.
anglemin	196	Plane angle, minutes.
anglesec	197	Plane angle, seconds.
ha	198	Area, hectares.
tonne	199	Mass in tons, "tonne" or "metric ton" (1000 kg = 1 Mg).
bar	214	Pressure in bars, (1 bar = 100 kPa).
mmHg	215	Pressure, millimetres of mercury (1 mmHg is approximately 133.3 Pa).
M	217	Length, nautical miles (1 M = 1852 m).
kn	219	Speed, knots (1 kn = 1852/3600) m/s.
Mx	276	Magnetic flux, maxwells (1 Mx = 10 ⁻⁸ Wb).
G	277	Magnetic flux density, gaussses (1 G = 10 ⁻⁴ T).
Oe	278	Magnetic field in oersteds, (1 Oe = (103/4p) A/m).
Vh	280	Volt-hour, Volt hours.
WPerA		Active power per current flow, watts per Ampere.
onePerHz		Reciprocal of frequency (1/Hz).
VPerVAr		Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.
ohmPerm	86	Electric resistance per length in ohms per metre ((V/A)/m).
kgPerJ		Weight per energy in kilograms per joule (kg/J). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
JPers		Energy rate in joules per second (J/s).

511 **4 Detailed Profile Specification - GLSK**

512 **4.1 General**

513 This package contains generation and load shift keys profile.

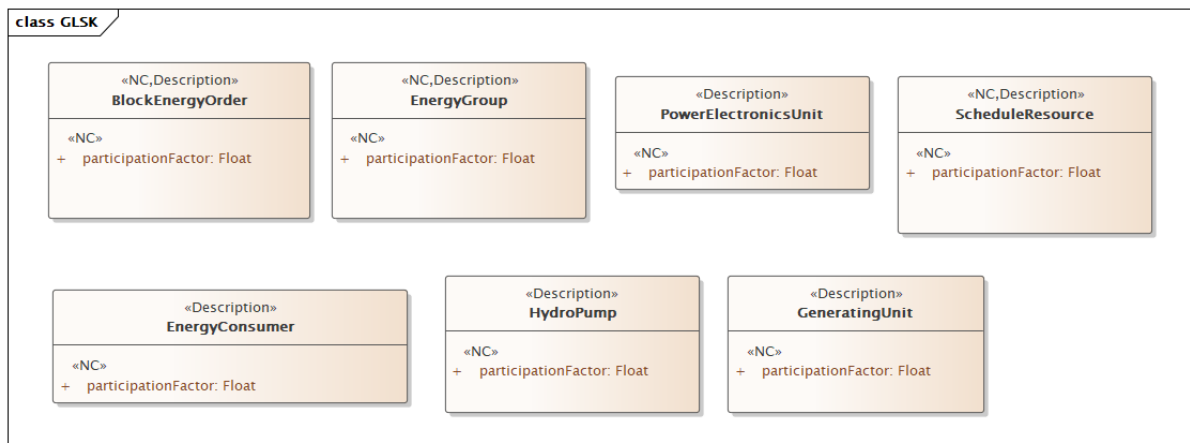

514

515 **Figure 3 – Class diagram GLSKProfile::GLSK**

516 Figure 3: The diagram shows generation and load shift keys related classes.

517 **4.2 (Description) EnergyConsumer root class**

518 Generic user of energy - a point of consumption on the power system model.

519 EnergyConsumer.pfixed, .qfixed, .pfixedPct and .qfixedPct have meaning only if there is no
520 LoadResponseCharacteristic associated with EnergyConsumer or if
521 LoadResponseCharacteristic.exponentModel is set to False.

522 Table 28 shows all attributes of EnergyConsumer.

523 **Table 28 – Attributes of GLSKProfile::EnergyConsumer**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

524

525 **4.3 (Description) HydroPump root class**

526 A synchronous motor-driven pump, typically associated with a pumped storage plant.

527 Table 29 shows all attributes of HydroPump.

528 **Table 29 – Attributes of GLSKProfile::HydroPump**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

529

530 **4.4 (NC,Description) BlockEnergyOrder root class**

531 The order given by a block dispatch instruction that are distributing the energy over the energy
532 components.

533 Table 30 shows all attributes of BlockEnergyOrder.

534 **Table 30 – Attributes of GLSKProfile::BlockEnergyOrder**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

535

536 **4.5 (NC,Description) EnergyGroup root class**

537 A group of energy consumers and/or energy producers used for forecasting and/or scheduling
538 slack distribution and area interchange control.

539 Table 31 shows all attributes of EnergyGroup.

540 **Table 31 – Attributes of GLSKProfile::EnergyGroup**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

541

542 **4.6 (Description) GeneratingUnit root class**

543 A single or set of synchronous machines for converting mechanical power into alternating-
544 current power. For example, individual machines within a set may be defined for scheduling
545 purposes while a single control signal is derived for the set. In this case there would be a
546 GeneratingUnit for each member of the set and an additional GeneratingUnit corresponding to
547 the set.

548 Table 32 shows all attributes of GeneratingUnit.

549 **Table 32 – Attributes of GLSKProfile::GeneratingUnit**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

550

551 **4.7 (Description) PowerElectronicsUnit root class**

552 A generating unit or battery or aggregation that connects to the AC network using power
553 electronics rather than rotating machines.

554 Table 33 shows all attributes of PowerElectronicsUnit.

555 **Table 33 – Attributes of GLSKProfile::PowerElectronicsUnit**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

556

557 **4.8 (NC,Description) ScheduleResource root class**

558 A schedule resource is a market-based method for handling participation of small units,
559 particularly located on the lower voltage level that is controlled by a Distributed System
560 Operator (DSO). It is a collection of units that can operate in the market by providing bids, offers
561 and a resulting committed operational schedule for the collection.

562 Table 34 shows all attributes of ScheduleResource.

563 **Table 34 – Attributes of GLSKProfile::ScheduleResource**

name	mult	type	description
participationFactor	1..1	Float	(NC) Situation economic participation factor.

564

565 **4.9 Date primitive**

566 Date as "yyyy-mm-dd", which conforms with ISO 8601. UTC time zone is specified as "yyyy-
567 mm-ddZ". A local timezone relative UTC is specified as "yyyy-mm-dd(+/-)hh:mm".

568 **4.10 DateTime primitive**

569 Date and time as "yyyy-mm-ddThh:mm:ss.sss", which conforms with ISO 8601. UTC time zone
570 is specified as "yyyy-mm-ddThh:mm:ss.sssZ". A local timezone relative UTC is specified as

571 "yyyy-mm-ddThh:mm:ss.sss-hh:mm". The second component (shown here as "ss.sss") could
572 have any number of digits in its fractional part to allow any kind of precision beyond seconds.

573 **4.11 Float primitive**

574 A floating point number. The range is unspecified and not limited.

575 **4.12 String primitive**

576 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
577 length is unspecified and unlimited.

578

579

580

581

Annex A (informative): Sample data

582 A.1 General

583 This Annex is designed to illustrate the profile by using fragments of sample data. It is not meant
584 to be a complete set of examples covering all possibilities of using the profile. Defining a
585 complete set of test data is considered a separate activity to be performed for the purpose of
586 setting up interoperability testing and conformity related to this profile.

587 A.2 Sample instance data

588 Intentionally left blank. Sample data will be produced at later stage.

589

590