



European Network of
Transmission System Operators
for Electricity

SECURITY ANALYSIS RESULT PROFILE SPECIFICATION

2021-04-21

SOC APPROVED
VERSION 1.0

1 Copyright notice:

2 **Copyright © ENTSO-E. All Rights Reserved.**

3 This document and its whole translations may be copied and furnished to others, and derivative
4 works that comment on or otherwise explain it or assist in its implementation may be prepared,
5 copied, published and distributed, in whole or in part, without restriction of any kind, provided
6 that the above copyright notice and this paragraph are included on all such copies and
7 derivative works. However, this document itself may not be modified in any way, except for
8 literal and whole translation into languages other than English and under all circumstances, the
9 copyright notice or references to ENTSO-E may not be removed.

10 This document and the information contained herein is provided on an "as is" basis.

11 **ENTSO-E DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT**
12 **LIMITED TO ANY WARRANTY THAT THE USE OF THE INFORMATION HEREIN WILL NOT**
13 **INFRINGE ANY RIGHTS OR ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR**
14 **FITNESS FOR A PARTICULAR PURPOSE.**

15 **This document is maintained by the ENTSO-E CIM EG. Comments or remarks are to be**
16 **provided at cim@entsoe.eu**

17 **NOTE CONCERNING WORDING USED IN THIS DOCUMENT**

18 The force of the following words is modified by the requirement level of the document in which
19 they are used.

- 20 • SHALL: This word, or the terms "REQUIRED" or "MUST", means that the definition is an
21 absolute requirement of the specification.
- 22 • SHALL NOT: This phrase, or the phrase "MUST NOT", means that the definition is an
23 absolute prohibition of the specification.
- 24 • SHOULD: This word, or the adjective "RECOMMENDED", means that there may exist valid
25 reasons in particular circumstances to ignore a particular item, but the full implications must
26 be understood and carefully weighed before choosing a different course.
- 27 • SHOULD NOT: This phrase, or the phrase "NOT RECOMMENDED", means that there may
28 exist valid reasons in particular circumstances when the particular behaviour is acceptable
29 or even useful, but the full implications should be understood and the case carefully weighed
30 before implementing any behaviour described with this label.
- 31 • MAY: This word, or the adjective "OPTIONAL", means that an item is truly optional.

32

33

Revision History

Version	Release	Date	Paragraph	Comments
1	0	2021-04-21		Approved by SOC.

34	CONTENTS		
35	Copyright notice:.....		2
36	Revision History.....		3
37	CONTENTS		4
38	1 Introduction		6
39	2 Application profile specification		6
40	2.1 Version information		6
41	2.2 Constraints naming convention		6
42	2.3 Profile constraints		7
43	2.4 Metadata.....		9
44	2.4.1 Constraints		9
45	2.4.2 Reference metadata		10
46	3 Detailed Profile Specification		10
47	3.1 General.....		10
48	3.2 (md) FullModel.....		13
49	3.3 (md) Model root class		13
50	3.4 (abstract,CSA) Region root class		18
51	3.5 (CSA) LimitViolation root class.....		18
52	3.6 (abstract) Contingency root class		18
53	3.7 (abstract) OperationalLimit root class.....		18
54	3.8 UnitMultiplier enumeration		19
55	3.9 UnitSymbol enumeration		19
56	3.10 PerCent datatype		25
57	3.11 Boolean primitive		25
58	3.12 Date primitive.....		25
59	3.13 DateTime primitive		25
60	3.14 (eumd) DateTimeStamp primitive		25
61	3.15 Duration primitive.....		25
62	3.16 Float primitive		26
63	3.17 (profcim) IRI primitive.....		26
64	3.18 (profcim) URL primitive		26
65	3.19 String primitive.....		26
66	3.20 (profcim) StringFixedLanguage primitive		26
67	3.21 (profcim) StringIRI primitive		26
68	Annex A (informative): Sample data		27
69	A.1 General.....		27
70	A.2 Header.....		27
71	A.3 Security analysis result		28
72			
73	List of figures		
74	Figure 1 – Class diagram		
75	SecurityAnalysisResultProfile::HeaderSecurityAnalysisResultProfile		11
76	Figure 2 – Class diagram SecurityAnalysisResultProfile::SecurityAnalysisResultProfile		12

77	Figure 3 – Class diagram	
78	SecurityAnalysisResultProfile::SecurityAnalysisResultDatatypes	12
79		
80	List of tables	
81	Table 1 – Attributes of SecurityAnalysisResultProfile::FullModel	13
82	Table 2 – Attributes of SecurityAnalysisResultProfile::Model	13
83	Table 3 – Attributes of SecurityAnalysisResultProfile::LimitViolation	18
84	Table 4 – Association ends of SecurityAnalysisResultProfile::LimitViolation with other	
85	classes	18
86	Table 5 – Literals of SecurityAnalysisResultProfile::UnitMultiplier	19
87	Table 6 – Literals of SecurityAnalysisResultProfile::UnitSymbol	20
88	Table 7 – Attributes of SecurityAnalysisResultProfile::PerCent	25
89		

90 1 Introduction

91 The security analysis result profile is a profile to exchange a security analysis result.

92 The security analysis result is output data for security analysis.

93 The security analysis result includes each limit violation detected for each assessed element
94 and for a given contingency. The limit violation has a direct association to operational limit and
95 contingency. The association to the operational limit provides information on the following:

- 96 - The terminal (the end of the equipment) where the limit is defined
- 97 - The equipment to which the limit is related
- 98 - The type of the limit e.g. PATL, TATL, etc including the relevant time phase and other
99 conditions

100 The association to the contingency provides information which contingency was simulated when
101 this limit violation was detected.

102

103 2 Application profile specification

104 2.1 Version information

105 The content is generated from UML model file CGMES30v25_501-20v01_HeaderMetaData-
106 10v08_CSA01v35.eap.

107 This edition is based on the IEC 61970 UML version 'IEC61970CIM17v40', dated '2020-08-24'.

- 108 - Title: Security Analysis Result Vocabulary
- 109 - Keyword: SAR
- 110 - Description: This vocabulary is describing the security analysis result profile.
- 111 - Version IRI: <http://entsoe.eu/ns/CIM/SecurityAnalysisResult-EU/1.0>
- 112 - Version info: 1.0.0
- 113 - Prior version:
- 114 - Conforms to: urn:iso:std:iec:61970-600-2:ed-1|urn:iso:std:iec:61970-301:ed-
115 7:amd1|file://iec61970cim17v40_iec61968cim13v13a_iec62325cim03v17a.eap|urn:iso:
116 std:iec:61970-401:draft:ed-1|urn:iso:std:iec:61970-501:draft:ed-2|file://CGMES-
117 30v25_501-20v01.eap
- 118 - Identifier: urn:uuid:7d53a1b2-0dcc-4556-b868-6ed099bd9ac9

119

120 2.2 Constraints naming convention

121 The naming of the rules shall not be used for machine processing. The rule names are just a
122 string. The naming convention of the constraints is as follows.

123 "{rule.Type}:{rule.Standard}:{rule.Profile}:{rule.Property}:{rule.Name}"

124 where

- 125 rule.Type: C – for constraint; R – for requirement
- 126 rule.Standard: the number of the standard e.g. 301 for 61970-301, 456 for 61970-456, 13 for
127 61968-13. 61970-600 specific constraints refer to 600 although they are related to one or
128 combination of the 61970-450 series profiles. For CSA profiles, CSA is used.
- 129 rule.Profile: the abbreviation of the profile, e.g. TP for Topology profile. If set to “ALL” the
130 constraint is applicable to all IEC 61970-600 profiles.
- 131 rule.Property: for UML classes, the name of the class, for attributes and associations, the name
132 of the class and attribute or association end, e.g. EnergyConsumer, IdentifiedObject.name, etc.
133 If set to “NA” the property is not applicable to a specific UML element.
- 134 rule.Name: the name of the rule. It is unique for the same property.
- 135 Example: C:600:ALL:IdentifiedObject.name:stringLength

136

137

138 2.3 Profile constraints

139 This clause defines requirements and constraints that shall be fulfilled by applications that
140 conform to this document.

141 This document is the master for rules and constraints tagged "CSA". For the sake of self-
142 containment, the list below also includes a copy of the relevant rules from IEC 61970-452,
143 tagged "452".

- 144 • C:452:ALL:NA:datatypes

145 According to 61970-501, datatypes are not exchanged in the instance data. The
146 UnitMultiplier is 1 in cases none value is specified in the profile.

- 147 • R:452:ALL:NA:exchange

148 Optional and required attributes and associations must be imported and exported if they
149 are in the model file prior to import.

- 150 • R:452:ALL:NA:exchange1

151 If an optional attribute does not exist in the imported file, it does not have to be exported
152 in case exactly the same data set is exported, i.e. the tool is not obliged to automatically
153 provide this attribute. If the export is resulting from an action by the user performed after
154 the import, e.g. data processing or model update the export can contain optional
155 attributes.

- 156 • R:452:ALL:NA:exchange2

157 In most of the profiles the selection of optional and required attributes is made so as to
158 ensure a minimum set of required attributes without which the exchange does not fulfil
159 its basic purpose. Business processes governing different exchanges can require
160 mandatory exchange of certain optional attributes or associations. Optional and required
161 attributes and associations shall therefore be supported by applications which claim
162 conformance with certain functionalities of the IEC 61970-452. This provides flexibility
163 for the business processes to adapt to different business requirements and base the
164 exchanges on IEC 61970-452 compliant applications.

- 165 • R:452:ALL:NA:exchange3

- 166 An exporter may, at his or her discretion, produce a serialization containing additional
167 class data described by the CIM Schema but not required by this document provided
168 these data adhere to the conventions established in Clause 5.
- 169 • R:452:ALL:NA:exchange4
- 170 From the standpoint of the model import used by a data recipient, the document
171 describes a subset of the CIM that importing software shall be able to interpret in order
172 to import exported models. Data providers are free to exceed the minimum requirements
173 described herein as long as their resulting data files are compliant with the CIM Schema
174 and the conventions established in Clause 5. The document, therefore, describes
175 additional classes and class data that, although not required, exporters will, in all
176 likelihood, choose to include in their data files. The additional classes and data are
177 labelled as required (cardinality 1..1) or as optional (cardinality 0..1) to distinguish them
178 from their required counterparts. Please note, however, that data importers could
179 potentially receive data containing instances of any and all classes described by the
180 CIM Schema.
- 181 • R:452:ALL:NA:cardinality
- 182 The cardinality defined in the CIM model shall be followed, unless a more restrictive
183 cardinality is explicitly defined in this document. For instance, the cardinality on the
184 association between VoltageLevel and BaseVoltage indicates that a VoltageLevel shall
185 be associated with one and only one BaseVoltage, but a BaseVoltage can be associated
186 with zero to many VoltageLevels.
- 187 • R:452:ALL:NA:associations
- 188 Associations between classes referenced in this document and classes not referenced
189 here are not required regardless of cardinality.
- 190 • R:452:ALL:IdentifiedObject.name:rule
- 191 The attribute “name” inherited by many classes from the abstract class IdentifiedObject
192 is not required to be unique. It must be a human readable identifier without additional
193 embedded information that would need to be parsed. The attribute is used for purposes
194 such as User Interface and data exchange debugging. The MRID defined in the data
195 exchange format is the only unique and persistent identifier used for this data exchange.
196 The attribute IdentifiedObject.name is, however, always required for CoreEquipment
197 profile and Short Circuit profile.
- 198 • R:452:ALL:IdentifiedObject.description:rule
- 199 The attribute “description” inherited by many classes from the abstract class
200 IdentifiedObject must contain human readable text without additional embedded
201 information that would need to be parsed.
- 202 • R:452:ALL:NA:uniqueIdentifier
- 203 All IdentifiedObject-s shall have a persistent and globally unique identifier (Master
204 Resource Identifier - mRID).
- 205 • R:452:ALL:NA:unitMultiplier
- 206 For exchange of attributes defined using CIM Data Types (ActivePower, Susceptance,
207 etc.) a unit multiplier of 1 is used if the UnitMultiplier specified in this document is “none”.
- 208 • C:452:ALL:IdentifiedObject.name:stringLength

- 209 The string IdentifiedObject.name has a maximum of 128 characters.
- 210
- C:452:ALL:IdentifiedObject.description:stringLength
- 211 The string IdentifiedObject.description is maximum 256 characters.
- 212
- C:452:ALL:NA:float
- 213 An attribute that is defined as float (e.g. has a type Float or a type which is a Datatype
214 with .value attribute of type Float) shall support ISO/IEC 60559:2020 for floating-point
215 arithmetic using single precision floating point. A single precision float supports 7
216 significant digits where the significant digits are described as an integer, or a decimal
217 number with 6 decimal digits. Two float values are equal when the significant with 7
218 digits are identical, e.g. 1234567 is equal 1.234567E6 and so are 1.2345678 and
219 1.234567E0.
- 220
- R:CSA:ALL:Region:reference
- 221 The reference to the Region is normally a reference to the capacity calculation region,
222 which is identified by “Y” EIC code of the capacity calculation region.
- 223
- R:CSA:ALL:SystemOperator:reference
- 224 The reference to the System Operator is normally identified by “X” EIC code of TSO.
- 225
- C:CSA:SAR:LimitViolation.Contingency:multiplicity
- 226 if LimitViolation.inBaseCase equals false, the multiplicity of the association end
227 LimitViolation.Contingency is restricted to 1.
- 228 If LimitViolation.inBaseCase equals true, the association LimitViolation.Contingency
229 shall not be exchanged.

230 2.4 Metadata

231

232 ENTSO-E agreed to extend the header and metadata definitions by IEC 61970-552 Ed2. This
233 new header definitions rely on W3C recommendations which are used worldwide and are
234 positively recognised by the European Commission. The new definitions of the header mainly
235 use Provenance ontology (PROV-O), Time Ontology and Data Catalog Vocabulary (DCAT). The
236 global new header is included in the metadata and document header specification document.

237 For this profile, header definitions are embedded directly in the profile. The header and the
238 payload are in principle two different profiles, but they are currently implemented as one profile
239 specification due to limitation in the current standards. With the approval of IEC 61970-501 Ed2
240 it will be possible to export it as two embedded profiles.

241

242 2.4.1 Constraints

243 The identification of the constraints related to the metadata follows the same convention for
244 naming of the constraints as for profile constraints.

- 245 • R:CSA:ALL:wasAttributedTo:usage

246 The prov:wasAttributedTo should normally be the “X” EIC code of the actor (prov:Agent).

247


248 **2.4.2 Reference metadata**

249 The header defined for this profile requires availability of a set of reference metadata. For
250 instance, the attribute `prov:wasGeneratedBy` requires a reference to an activity which produced
251 the model or the related process. The activities are defined as reference metadata and their
252 identifiers are referenced from the header to enable the receiving entity to retrieve the “static”
253 (reference) information that is not modified frequently. This approach imposes a requirement
254 that both the sending entity and the receiving entity have access to a unique version of the
255 reference metadata. Therefore, each business process shall define which reference metadata
256 is used and where it is located.

257 **3 Detailed Profile Specification**

258 **3.1 General**

259 This package contains the security analysis result profile.

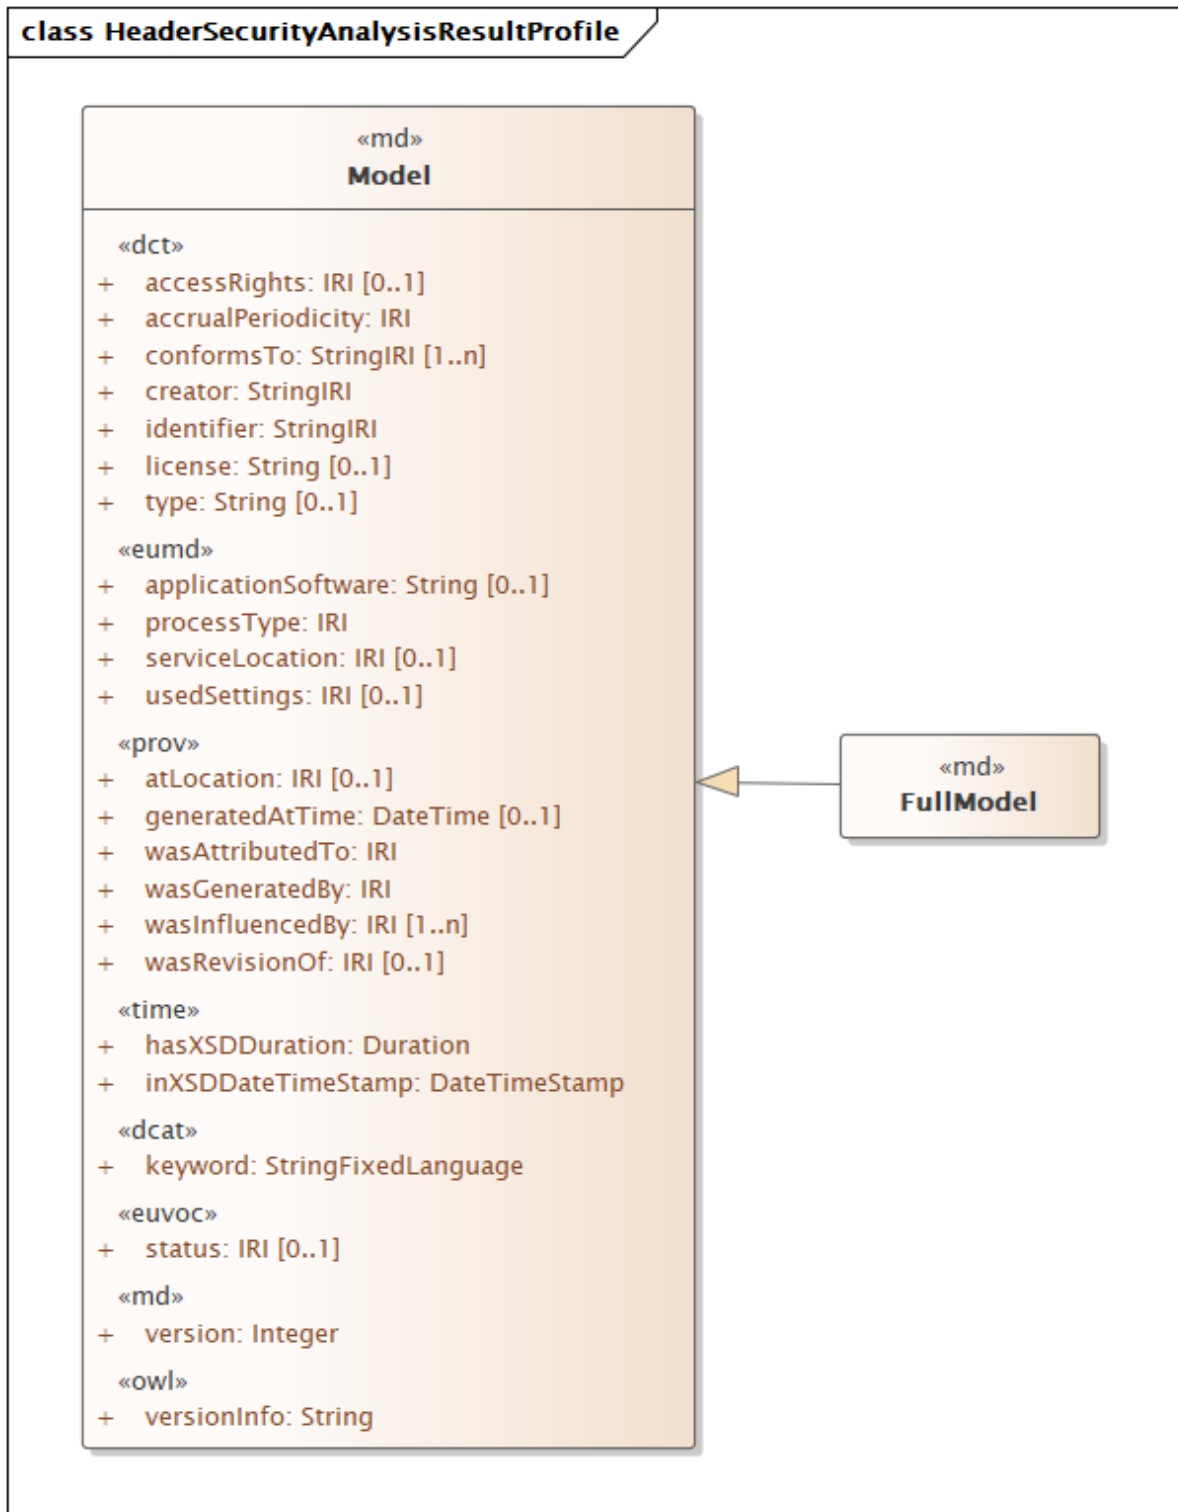

260


261

262


**Figure 1 – Class diagram
SecurityAnalysisResultProfile::HeaderSecurityAnalysisResultProfile**

263

Figure 1: The diagram contains classes related to the header.

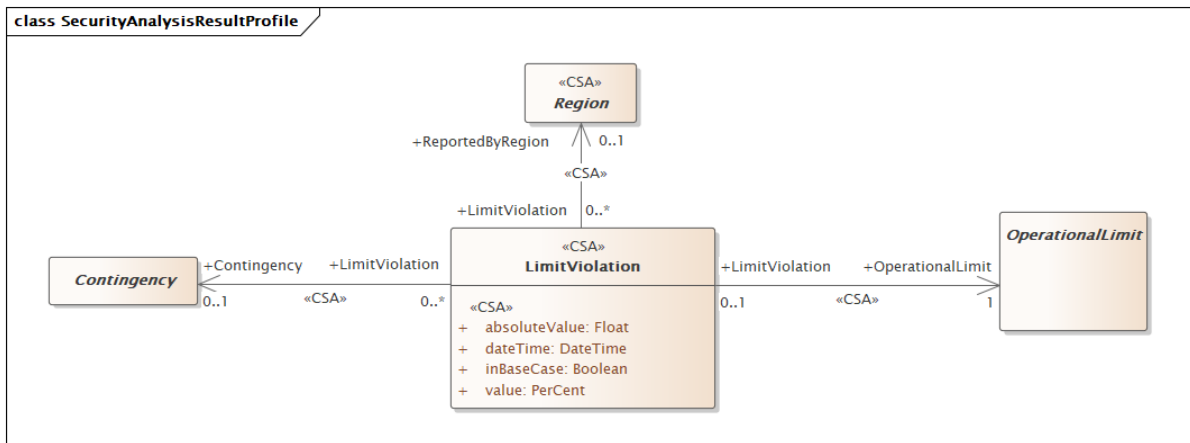

264
265 **Figure 2 – Class diagram SecurityAnalysisResultProfile::SecurityAnalysisResultProfile**
266 Figure 2: The diagram contains the main classes used in the profile.

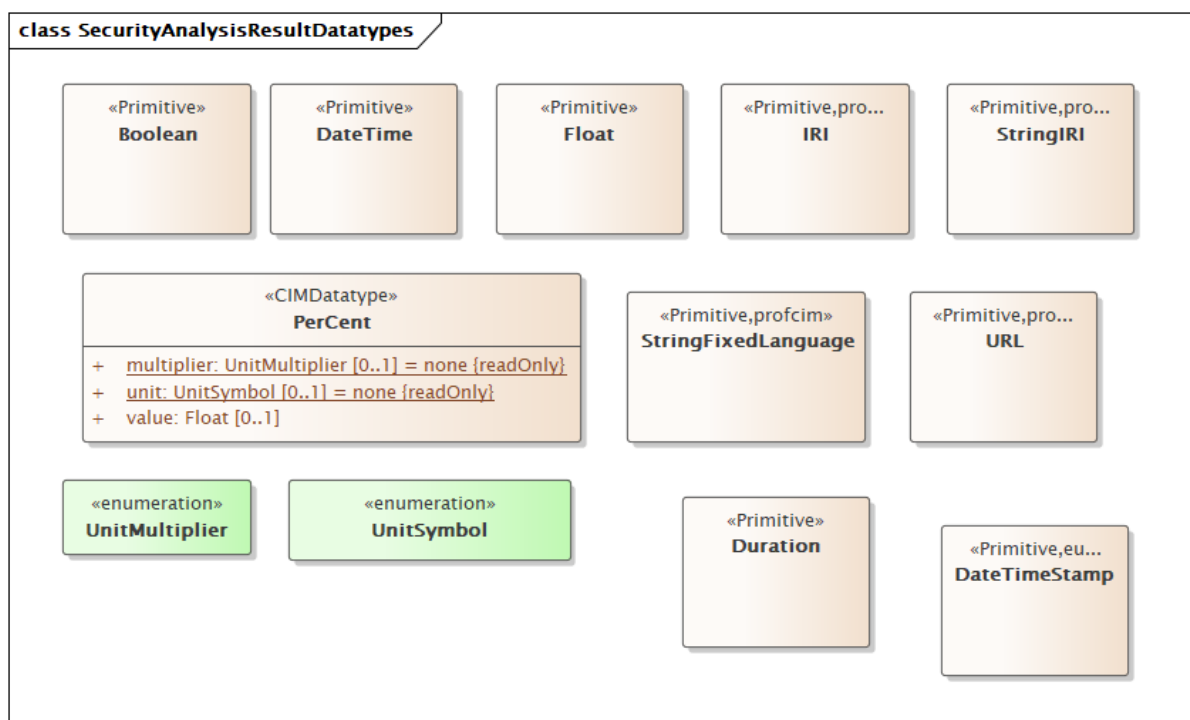

267
268 **Figure 3 – Class diagram**
269 **SecurityAnalysisResultProfile::SecurityAnalysisResultDatatypes**

270 Figure 3: The diagram shows datatypes that are used by classes in the profile. Stereotypes are
271 used to describe the datatypes. The following stereotypes are defined:
272 <<enumeration>> A list of permissible constant values.
273 <<Primitive>> The most basic data types used to compose all other data types.
274 <<CIMDatatype>> A datatype that contains a value attribute, an optional unit of measure and
275 a unit multiplier. The unit and multiplier may be specified as a static variable initialized to the
276 allowed value.
277 <<Compound>> A composite of Primitive, enumeration, CIMDatatype or other Compound
278 classes, as long as the Compound classes do not recurse.
279 For all datatypes both positive and negative values are allowed unless stated otherwise for a
280 particular datatype.

281 **3.2 (md) FullModel**282 Inheritance path = [Model](#)

283 It represents the full model header and its contents is described by the Model class.

284 Table 1 shows all attributes of FullModel.

285 **Table 1 – Attributes of SecurityAnalysisResultProfile::FullModel**

name	mult	type	description
version	1..1	Integer	(md) inherited from: Model
accrualPeriodicity	1..1	IRI	(dct) inherited from: Model
status	0..1	IRI	(euvoc) inherited from: Model
applicationSoftware	0..1	String	(eumd) inherited from: Model
keyword	1..1	StringFixedLanguage	(dcat) inherited from: Model
accessRights	0..1	IRI	(dct) inherited from: Model
conformsTo	1..n	StringIRI	(dct) inherited from: Model
identifier	1..1	StringIRI	(dct) inherited from: Model
license	0..1	String	(dct) inherited from: Model
type	0..1	String	(dct) inherited from: Model
generatedAtTime	0..1	DateTime	(prov) inherited from: Model
atLocation	0..1	IRI	(prov) inherited from: Model
wasInfluencedBy	1..n	IRI	(prov) inherited from: Model
wasGeneratedBy	1..1	IRI	(prov) inherited from: Model
wasAttributedTo	1..1	IRI	(prov) inherited from: Model
wasRevisionOf	0..1	IRI	(prov) inherited from: Model
inXSDDdateTimeStamp	1..1	DateTimeStamp	(time) inherited from: Model
hasXSDDuration	1..1	Duration	(time) inherited from: Model
usedSettings	0..1	IRI	(eumd) inherited from: Model
processType	1..1	IRI	(eumd) inherited from: Model
creator	1..1	StringIRI	(dct) inherited from: Model
serviceLocation	0..1	IRI	(eumd) inherited from: Model

286

287 **3.3 (md) Model root class**288 A Model is a collection of data describing instances, objects or entities, real or computed. In
289 the context of CIM the semantics of the data is defined by profiles. Hence a model can contain
290 equipment data, power flow initial values, power flow results etc.291 The Model class describes the header content that is the same for the FullModel and the
292 DifferenceModel. A Model is identified by an rdf:about attribute. The rdf:about attribute uniquely
293 describes the model data and not the CIMXML document. A new rdf:about identification is
294 generated for created documents only when the model data has changed. A repeated creation
295 of documents from unchanged model data shall have the same rdf:about identification as
296 previous document generated from the same model data.

297 Table 2 shows all attributes of Model.

298 **Table 2 – Attributes of SecurityAnalysisResultProfile::Model**

name	mult	type	description
version	1..1	Integer	(md) The version of the model. If the instance file is imported and exported with no change, the version number is kept the same. The version

name	mult	type	description
			changes only if the content of the file changes. It is the same logic as for the header id. The version is the human readable id. [CIM context: It relates to the version of the document and not the version of the model which is serialized.]
accrualPeriodicity	1..1	IRI	(dct) The frequency with which items are added to a collection. [CIM context: Reference to the time frame.]
status	0..1	IRI	(euvoc) Indicates the status of a skos:Concept or a skosxl:Label, or any resource related to controlled vocabulary management. [CIM context: The condition or position of an object with regard to its standing. (Validated, Primary, Backup etc.)].
applicationSoftware	0..1	String	(eumd) Identifies the application software which generated this instance file. The application software term is defined in ISO/IEC/IEEE 24765:2017. The application software can be identified either: - as a string which contains information on the software name and version, e.g. <tool_name>-<major_version>.<minor_version>.<patch>, or - as a reference to a software identification tag as defined by ISO/IEC 19770-2:2015 and ISO/IEC/IEEE 24765:2017.
keyword	1..1	StringFixedLanguage	(dcat) A keyword or tag describing a resource. [CIM context: The intended content type of the model, usually the profile keyword. Used to identify what profiles and content is expected in the document, e.g., Equipment, Boundary, SSH, AE, etc. The same keyword is used for different versions of same profile. It can be also used to identify different content based on the same profile. For instance, as the equipment profile can be used for both boundary data and equipment not related to boundary, the keyword is different to indicate that boundary data is exchanged. In order to avoid ambiguity the property is not exchanged in cases where the document contains multiple profiles referenced by dct:conformsTo.]
accessRights	0..1	IRI	(dct) Information about who access the resource or an indication of its security status. Access Rights may include information regarding access or restrictions based on privacy, security, or other policies. [CIM context: Reference to the confidentiality level that shall be applied when handling this model.]
conformsTo	1..n	StringIRI	(dct) An established standard to which the described resource conforms. [CIM context: An IRI describing the profile that governs this model. It uniquely identifies the profile and its version. Multiple instances of the property describe all standards or specifications to which

name	mult	type	description
			<p>the model and the document representing this model conform to.</p> <p>A document would normally conform to profile definitions, the constraints that relate to the profile and/or the set of business specific constraints. A reference to a machine- readable constraints or specification indicates that the document was tested against these constraints and it conforms to them.].</p>
identifier	1..1	StringIRI	<p>(dct) An unambiguous reference to the resource within a given context. Recommended practice is to identify the resource by means of a string conforming to an identification system. Examples include International Standard Book Number (ISBN), Digital Object Identifier (DOI), and Uniform Resource Name (URN). Persistent identifiers should be provided as HTTP URIs.</p> <p>[CIM context: A unique identifier of the model which is serialised in the document where the header is located. The identifier is persistent for a given version of the model and shall change when the model changes. If a model is serialized as complete (full) model or as difference model exchange the identifier shall be the same. The identifier shall not be used as an identifier of the document which can be different for a given version of a model.].</p>
license	0..1	String	<p>(dct) A legal document giving official permission to do something with the resource. Recommended practice is to identify the license document with a URI. If this is not possible or feasible, a literal value that identifies the license may be provided.</p> <p>[CIM context: Reference to the license under which the data is made available. If no license holder is defined, then the original data provider holds the license.].</p>
type	0..1	String	<p>(dct) The nature or genre of the resource. Recommended practice is to use a controlled vocabulary such as the DCMI Type Vocabulary [DCMI-TYPE]. To describe the file format, physical medium, or dimensions of the resource, use the property Format.</p>
generatedAtTime	0..1	DateTime	<p>(prov) Generation is the completion of production of a new entity by an activity. This entity did not exist before generation and becomes available for usage after this generation.</p> <p>[CIM context: The date and time when the model was serialized in the document where the header is located. The format is an extended format according to the ISO 8601-2005. European exchanges shall refer to UTC.].</p>
atLocation	0..1	IRI	<p>(prov) A location can be an identifiable geographic place (ISO 19112), but it can also be a non-geographic place such as a directory, row, or column. As such, there are numerous ways in which location can be expressed, such as by a coordinate, address, landmark, and so forth.</p> <p>[CIM context:</p>

name	mult	type	description
			Reference to a region or a domain for which this model is provided.].
wasInfluencedBy	1..n	IRI	(prov) Influence is the capacity of an entity, activity, or agent to have an effect on the character, development, or behavior of another by means of usage, start, end, generation, invalidation, communication, derivation, attribution, association, or delegation. [CIM context: A reference to the model on which the model serialised in this document depends on. The references are maintained by the producer of the model. Minimum requirements for the dependency are specified and can be restricted within a business process as long as they do not contradict requirements by standards. For instance, IEC 61970-600-1 defines minimum requirements for the profiles defined in that standard.].
wasGeneratedBy	1..1	IRI	(prov) Generation is the completion of production of a new entity by an activity. This entity did not exist before generation and becomes available for usage after this generation. [CIM context: Reference to an activity or the exact business nature (process, configuration) which produced or uses the model.].
wasAttributedTo	1..1	IRI	(prov) Attribution is the ascribing of an entity to an agent. [CIM context: Reference to the agent (or service provider) from which the model originates.].
wasRevisionOf	0..1	IRI	(prov) A revision is a derivation for which the resulting entity is a revised version of some original. The implication here is that the resulting entity contains substantial content from the original. Revision is a particular case of derivation. [CIM context: When a model is updated the resulting model supersedes the models that were used as basis for the update. Hence this is a reference to the model which are superseded by this model. A model can supersede 1 or more models, e.g. a difference model or a full model supersede multiple models (difference or full). In this case, multiple properties are included in the header. The referenced document(s) is (are) identified by the URN/MRID/UUID in the FullModel rdf:about attribute when full model(s) is (are) referenced and by the URN/MRID/UUID in the DifferenceModel rdf:about attribute when difference model(s) is (are) referenced.].
inXSDDateTimeStamp	1..1	DateTimeStamp	(time) Position of an instant, expressed using xsd:dateTimeStamp, in which the time-zone field is mandatory. [CIM context: The date and time that this model represents, i.e. for which the model is (or was) valid. If used in relation with hasXSDDuration it indicates the beginning of the validity period. It is indicating either an instant (in cases where the model is only valid for a point in time) or the

name	mult	type	description
			start time of a period. If not provided the model is considered valid for any time stamp. The format is an extended format according to the ISO 8601-2005. European exchanges shall refer to UTC.].
hasXSDDuration	1..1	Duration	(time) Extent of a temporal entity, expressed using xsd:duration. [CIM context: The duration of the validity period of the model that it is serialized in the document where the header is located. It is only used in relation to the inXSDDateTimeStamp property which indicates the beginning of the validity period of the model. The end of the validity period is derived from both inXSDDateTimeStamp and hasXSDDuration.].
usedSettings	0..1	IRI	(eumd) Reference to a set of parameters describing used settings (e.g. power flow settings, process settings, etc.) applied to the model prior its serialisation.
processType	1..1	IRI	(eumd) The exact business nature. Reference to Business Process configurations.
creator	1..1	StringIRI	(dct) An entity responsible for making the resource. Recommended practice is to identify the creator with a URI. If this is not possible or feasible, a literal value that identifies the creator may be provided. [CIM context: The name of the agent (Modeling Authority) from which the model originates].
serviceLocation	0..1	IRI	(eumd) Reference to a service location (region or a domain).
versionInfo	0..1	String	(owl) The annotation property that provides version information for an ontology or another OWL construct. DCAT-AP definition: This property contains a version number or other version designation of the Dataset. OWL definition: An owl:versionInfo statement generally has as its object a string giving information about this version, for example RCS/CVS keywords. This statement does not contribute to the logical meaning of the ontology other than that given by the RDF(S) model theory. Although this property is typically used to make statements about ontologies, it may be applied to any OWL construct. For example, one could attach a owl:versionInfo statement to an OWL class. [CIM context: The version of the model. If the document is imported and exported with no change the version number is the kept same. The version changes only if the content of the model changes. It is the same logic as for the header identifier. The version is the human readable identifier.].

300 **3.4 (abstract,CSA) Region root class**

301 A region where the system operator belongs to.

302 **3.5 (CSA) LimitViolation root class**

303 Limit violation.

304 Table 3 shows all attributes of LimitViolation.

305 **Table 3 – Attributes of SecurityAnalysisResultProfile::LimitViolation**

name	mult	type	description
value	1..1	PerCent	(CSA) The value of the limit violation in percent related to the value of the operational limit that is violated. For instance, if the operational limit is 1000 A and the current flow is 1100 A the value is reported as 110 %.
absoluteValue	1..1	Float	(CSA) It is the absolute value which results from a power flow calculation. For instance, if the operational limit is 1000 A and the current flow is 1100 A the absoluteValue is reported as 1100 A.
dateTime	1..1	DateTime	(CSA) The date and time of the scenario time that was studied and at which the limit violation occurred.
inBaseCase	1..1	Boolean	(CSA) Indicates if the limit violation was detected in the base case. True means that the reported limit violation occurred in the base case. False means it did not occur in the base case. In case of false the association LimitViolation.Contingency is required.

306

307 Table 4 shows all association ends of LimitViolation with other classes.

308 **Table 4 – Association ends of SecurityAnalysisResultProfile::LimitViolation with other classes**

309

mult from	name	mult to	type	description
0..*	ReportedByRegion	0..1	Region	(CSA) The region which reports this limit violation.
0..*	Contingency	0..1	Contingency	(CSA) The contingency that has a limit violation.
0..1	OperationalLimit	1..1	OperationalLimit	(CSA) The operational limit that has a limit violation.

310

311 **3.6 (abstract) Contingency root class**

312 An event threatening system reliability, consisting of one or more contingency elements.

313 **3.7 (abstract) OperationalLimit root class**

314 A value and normal value associated with a specific kind of limit.

315 The sub class value and normalValue attributes vary inversely to the associated OperationalLimitType.acceptableDuration (acceptableDuration for short).

316 If a particular piece of equipment has multiple operational limits of the same kind (apparent power, current, etc.), the limit with the greatest acceptableDuration shall have the smallest limit value and the limit with the smallest acceptableDuration shall have the largest limit value. Note:

317 A large current can only be allowed to flow through a piece of equipment for a short duration without causing damage, but a lesser current can be allowed to flow for a longer duration.

321

322 **3.8 UnitMultiplier enumeration**

323 The unit multipliers defined for the CIM. When applied to unit symbols, the unit symbol is
324 treated as a derived unit. Regardless of the contents of the unit symbol text, the unit symbol
325 shall be treated as if it were a single-character unit symbol. Unit symbols should not contain
326 multipliers, and it should be left to the multiplier to define the multiple for an entire data type.

327 For example, if a unit symbol is "m2Pers" and the multiplier is "k", then the value is $k(m^{**2}/s)$,
328 and the multiplier applies to the entire final value, not to any individual part of the value. This
329 can be conceptualized by substituting a derived unit symbol for the unit type. If one imagines
330 that the symbol "P" represents the derived unit "m2Pers", then applying the multiplier "k" can
331 be conceptualized simply as "kP".

332 For example, the SI unit for mass is "kg" and not "g". If the unit symbol is defined as "kg", then
333 the multiplier is applied to "kg" as a whole and does not replace the "k" in front of the "g". In
334 this case, the multiplier of "m" would be used with the unit symbol of "kg" to represent one gram.
335 As a text string, this violates the instructions in IEC 80000-1. However, because the unit symbol
336 in CIM is treated as a derived unit instead of as an SI unit, it makes more sense to conceptualize
337 the "kg" as if it were replaced by one of the proposed replacements for the SI mass symbol. If
338 one imagines that the "kg" were replaced by a symbol "P", then it is easier to conceptualize the
339 multiplier "m" as creating the proper unit "mP", and not the forbidden unit "mkg".

340 Table 5 shows all literals of UnitMultiplier.

341 **Table 5 – Literals of SecurityAnalysisResultProfile::UnitMultiplier**

literal	value	description
y	-24	Yocto $10^{** -24}$.
z	-21	Zepto $10^{** -21}$.
a	-18	Atto $10^{** -18}$.
f	-15	Femto $10^{** -15}$.
p	-12	Pico $10^{** -12}$.
n	-9	Nano $10^{** -9}$.
micro	-6	Micro $10^{** -6}$.
m	-3	Milli $10^{** -3}$.
c	-2	Centi $10^{** -2}$.
d	-1	Deci $10^{** -1}$.
none	0	No multiplier or equivalently multiply by 1.
da	1	Deca $10^{** 1}$.
h	2	Hecto $10^{** 2}$.
k	3	Kilo $10^{** 3}$.
M	6	Mega $10^{** 6}$.
G	9	Giga $10^{** 9}$.
T	12	Tera $10^{** 12}$.
P	15	Peta $10^{** 15}$.
E	18	Exa $10^{** 18}$.
Z	21	Zetta $10^{** 21}$.
Y	24	Yotta $10^{** 24}$.

342

343 **3.9 UnitSymbol enumeration**

344 The derived units defined for usage in the CIM. In some cases, the derived unit is equal to an
345 SI unit. Whenever possible, the standard derived symbol is used instead of the formula for the
346 derived unit. For example, the unit symbol Farad is defined as "F" instead of "CPerV". In cases

347 where a standard symbol does not exist for a derived unit, the formula for the unit is used as
348 the unit symbol. For example, density does not have a standard symbol and so it is represented
349 as "kgPerm3". With the exception of the "kg", which is an SI unit, the unit symbols do not contain
350 multipliers and therefore represent the base derived unit to which a multiplier can be applied as
351 a whole.

352 Every unit symbol is treated as an unparseable text as if it were a single-letter symbol. The
353 meaning of each unit symbol is defined by the accompanying descriptive text and not by the
354 text contents of the unit symbol.

355 To allow the widest possible range of serializations without requiring special character handling,
356 several substitutions are made which deviate from the format described in IEC 80000-1. The
357 division symbol "/" is replaced by the letters "Per". Exponents are written in plain text after the
358 unit as "m3" instead of being formatted as "m" with a superscript of 3 or introducing a symbol
359 as in "m^3". The degree symbol "°" is replaced with the letters "deg". Any clarification of the
360 meaning for a substitution is included in the description for the unit symbol.

361 Non-SI units are included in list of unit symbols to allow sources of data to be correctly labelled
362 with their non-SI units (for example, a GPS sensor that is reporting numbers that represent feet
363 instead of meters). This allows software to use the unit symbol information correctly convert
364 and scale the raw data of those sources into SI-based units.

365 The integer values are used for harmonization with IEC 61850.

366 Table 6 shows all literals of UnitSymbol.

367

Table 6 – Literals of SecurityAnalysisResultProfile::UnitSymbol

literal	value	description
none	0	Dimension less quantity, e.g. count, per unit, etc.
m	2	Length in metres.
kg	3	Mass in kilograms. Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
s	4	Time in seconds.
A	5	Current in amperes.
K	6	Temperature in kelvins.
mol	7	Amount of substance in moles.
cd	8	Luminous intensity in candelas.
deg	9	Plane angle in degrees.
rad	10	Plane angle in radians (m/m).
sr	11	Solid angle in steradians (m ² /m ²).
Gy	21	Absorbed dose in grays (J/kg).
Bq	22	Radioactivity in becquerels (1/s).
degC	23	Relative temperature in degrees Celsius. In the SI unit system the symbol is °C. Electric charge is measured in coulomb that has the unit symbol C. To distinguish degree Celsius from coulomb the symbol used in the UML is degC. The reason for not using °C is that the special character ° is difficult to manage in software.
Sv	24	Dose equivalent in sieverts (J/kg).
F	25	Electric capacitance in farads (C/V).
C	26	Electric charge in coulombs (A·s).
S	27	Conductance in siemens.
H	28	Electric inductance in henrys (Wb/A).
V	29	Electric potential in volts (W/A).

literal	value	description
ohm	30	Electric resistance in ohms (V/A).
J	31	Energy in joules (N·m = C·V = W·s).
N	32	Force in newtons (kg·m/s ²).
Hz	33	Frequency in hertz (1/s).
lx	34	Illuminance in lux (lm/m ²).
lm	35	Luminous flux in lumens (cd·sr).
Wb	36	Magnetic flux in webers (V·s).
T	37	Magnetic flux density in teslas (Wb/m ²).
W	38	Real power in watts (J/s). Electrical power may have real and reactive components. The real portion of electrical power (I^2R or $VI\cos(\phi)$), is expressed in Watts. See also apparent power and reactive power.
Pa	39	Pressure in pascals (N/m ²). Note: the absolute or relative measurement of pressure is implied with this entry. See below for more explicit forms.
m2	41	Area in square metres (m ²).
m3	42	Volume in cubic metres (m ³).
mPers	43	Velocity in metres per second (m/s).
mPers2	44	Acceleration in metres per second squared (m/s ²).
m3Pers	45	Volumetric flow rate in cubic metres per second (m ³ /s).
mPerm3	46	Fuel efficiency in metres per cubic metres (m/m ³).
kgm	47	Moment of mass in kilogram metres (kg·m) (first moment of mass). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
kgPerm3	48	Density in kilogram/cubic metres (kg/m ³). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
m2Pers	49	Viscosity in square metres / second (m ² /s).
WPermK	50	Thermal conductivity in watt/metres kelvin.
JPerK	51	Heat capacity in joules/kelvin.
ppm	52	Concentration in parts per million.
rotPers	53	Rotations per second (1/s). See also Hz (1/s).
radPers	54	Angular velocity in radians per second (rad/s).
WPerm2	55	Heat flux density, irradiance, watts per square metre.
JPerm2	56	Insulation energy density, joules per square metre or watt second per square metre.
SPerm	57	Conductance per length (F/m).
KPers	58	Temperature change rate in kelvins per second.
PaPers	59	Pressure change rate in pascals per second.
JPerkgK	60	Specific heat capacity, specific entropy, joules per kilogram Kelvin.

literal	value	description
VA	61	Apparent power in volt amperes. See also real power and reactive power.
VAr	63	Reactive power in volt amperes reactive. The "reactive" or "imaginary" component of electrical power ($V\sin(\phi)$). (See also real power and apparent power). Note: Different meter designs use different methods to arrive at their results. Some meters may compute reactive power as an arithmetic value, while others compute the value vectorially. The data consumer should determine the method in use and the suitability of the measurement for the intended purpose.
cosPhi	65	Power factor, dimensionless. Note 1: This definition of power factor only holds for balanced systems. See the alternative definition under code 153. Note 2 : Beware of differing sign conventions in use between the IEC and EEL. It is assumed that the data consumer understands the type of meter in use and the sign convention in use by the utility.
Vs	66	Volt seconds (Ws/A).
V2	67	Volt squared (W^2/A^2).
As	68	Ampere seconds (A·s).
A2	69	Amperes squared (A^2).
A2s	70	Ampere squared time in square amperes (A^2s).
VAh	71	Apparent energy in volt ampere hours.
Wh	72	Real energy in watt hours.
VArh	73	Reactive energy in volt ampere reactive hours.
VPerHz	74	Magnetic flux in volt per hertz.
HzPers	75	Rate of change of frequency in hertz per second.
character	76	Number of characters.
charPers	77	Data rate (baud) in characters per second.
kgm2	78	Moment of mass in kilogram square metres ($kg\cdot m^2$) (Second moment of mass, commonly called the moment of inertia). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
dB	79	Sound pressure level in decibels. Note: multiplier "d" is included in this unit symbol for compatibility with IEC 61850-7-3.
WPers	81	Ramp rate in watts per second.
IPers	82	Volumetric flow rate in litres per second.
dBm	83	Power level (logarithmic ratio of signal strength , Bel-mW), normalized to 1mW. Note: multiplier "d" is included in this unit symbol for compatibility with IEC 61850-7-3.
h	84	Time in hours, hour = 60 min = 3600 s.
min	85	Time in minutes, minute = 60 s.
Q	100	Quantity power, Q.
Qh	101	Quantity energy, Qh.

literal	value	description
ohmm	102	Resistivity, ohm metres, (ρ).
APerm	103	A/m, magnetic field strength, amperes per metre.
V2h	104	Volt-squared hour, volt-squared-hours.
A2h	105	Ampere-squared hour, ampere-squared hour.
Ah	106	Ampere-hours, ampere-hours.
count	111	Amount of substance, Counter value.
ft3	119	Volume, cubic feet.
m3Perh	125	Volumetric flow rate, cubic metres per hour.
gal	128	Volume in gallons, US gallon (1 gal = 231 in ³ = 128 fl ounce).
Btu	132	Energy, British Thermal Units.
l	134	Volume in litres, litre = dm ³ = m ³ /1000.
lPerh	137	Volumetric flow rate, litres per hour.
lPerl	143	Concentration, The ratio of the volume of a solute divided by the volume of the solution. Note: Users may need use a prefix such a 'µ' to express a quantity such as 'µL/L'.
gPerg	144	Concentration, The ratio of the mass of a solute divided by the mass of the solution. Note: Users may need use a prefix such a 'µ' to express a quantity such as 'µg/g'.
molPerm3	145	Concentration, The amount of substance concentration, (c), the amount of solvent in moles divided by the volume of solution in m ³ .
molPermol	146	Concentration, Molar fraction, the ratio of the molar amount of a solute divided by the molar amount of the solution.
molPerkg	147	Concentration, Molality, the amount of solute in moles and the amount of solvent in kilograms.
sPers	149	Time, Ratio of time. Note: Users may need to supply a prefix such as 'µ' to show rates such as 'µs/s'.
HzPerHz	150	Frequency, rate of frequency change. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mHz/Hz'.
VPerV	151	Voltage, ratio of voltages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mV/V'.
APerA	152	Current, ratio of amperages. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mA/A'.
VPerVA	153	Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.
rev	154	Amount of rotation, revolutions.
kat	158	Catalytic activity, katal = mol / s.
JPerkg	165	Specific energy, Joules / kg.

literal	value	description
m3Uncompensated	166	Volume, cubic metres, with the value uncompensated for weather effects.
m3Compensated	167	Volume, cubic metres, with the value compensated for weather effects.
WPerW	168	Signal Strength, ratio of power. Note: Users may need to supply a prefix such as 'm' to show rates such as 'mW/W'.
therm	169	Energy, therms.
onePerm	173	Wavenumber, reciprocal metres, (1/m).
m3Perkg	174	Specific volume, cubic metres per kilogram, v.
Pas	175	Dynamic viscosity, pascal seconds.
Nm	176	Moment of force, newton metres.
NPerm	177	Surface tension, newton per metre.
radPers2	178	Angular acceleration, radians per second squared.
JPerm3	181	Energy density, joules per cubic metre.
VPerm	182	Electric field strength, volts per metre.
CPerm3	183	Electric charge density, coulombs per cubic metre.
CPerm2	184	Surface charge density, coulombs per square metre.
FPerm	185	Permittivity, farads per metre.
HPerm	186	Permeability, henrys per metre.
JPermol	187	Molar energy, joules per mole.
JPermolK	188	Molar entropy, molar heat capacity, joules per mole kelvin.
CPerkg	189	Exposure (x rays), coulombs per kilogram.
GyPers	190	Absorbed dose rate, grays per second.
WPersr	191	Radiant intensity, watts per steradian.
WPerm2sr	192	Radiance, watts per square metre steradian.
katPerm3	193	Catalytic activity concentration, katals per cubic metre.
d	195	Time in days, day = 24 h = 86400 s.
anglemin	196	Plane angle, minutes.
anglesec	197	Plane angle, seconds.
ha	198	Area, hectares.
tonne	199	Mass in tons, "tonne" or "metric ton" (1000 kg = 1 Mg).
bar	214	Pressure in bars, (1 bar = 100 kPa).
mmHg	215	Pressure, millimetres of mercury (1 mmHg is approximately 133.3 Pa).
M	217	Length, nautical miles (1 M = 1852 m).
kn	219	Speed, knots (1 kn = 1852/3600) m/s.
Mx	276	Magnetic flux, maxwells (1 Mx = 10 ⁻⁸ Wb).
G	277	Magnetic flux density, gaussses (1 G = 10 ⁻⁴ T).

literal	value	description
Oe	278	Magnetic field in oersteds, (1 Oe = (103/4π) A/m).
Vh	280	Volt-hour, Volt hours.
WPerA		Active power per current flow, watts per Ampere.
onePerHz		Reciprocal of frequency (1/Hz).
VPerVAr		Power factor, PF, the ratio of the active power to the apparent power. Note: The sign convention used for power factor will differ between IEC meters and EEI (ANSI) meters. It is assumed that the data consumers understand the type of meter being used and agree on the sign convention in use at any given utility.
ohmPerm	86	Electric resistance per length in ohms per metre ((V/A)/m).
kgPerJ		Weight per energy in kilograms per joule (kg/J). Note: multiplier "k" is included in this unit symbol for compatibility with IEC 61850-7-3.
JPers		Energy rate in joules per second (J/s).

368

369 **3.10 PerCent datatype**

370 Percentage on a defined base. For example, specify as 100 to indicate at the defined base.
371 Table 7 shows all attributes of PerCent.

372

Table 7 – Attributes of SecurityAnalysisResultProfile::PerCent

name	mult	type	description
value	0..1	Float	Normally 0 to 100 on a defined base.
unit	0..1	UnitSymbol	(const=none)
multiplier	0..1	UnitMultiplier	(const=none)

373

374 **3.11 Boolean primitive**

375 A type with the value space "true" and "false".

376 **3.12 Date primitive**

377 Date as "yyyy-mm-dd", which conforms with ISO 8601. UTC time zone is specified as "yyyy-
378 mm-ddZ". A local timezone relative UTC is specified as "yyyy-mm-dd(+/-)hh:mm".

379 **3.13 DateTime primitive**

380 Date and time as "yyyy-mm-ddThh:mm:ss.sss", which conforms with ISO 8601. UTC time zone
381 is specified as "yyyy-mm-ddThh:mm:ss.sssZ". A local timezone relative UTC is specified as
382 "yyyy-mm-ddThh:mm:ss.sss-hh:mm". The second component (shown here as "ss.sss") could
383 have any number of digits in its fractional part to allow any kind of precision beyond seconds.

384 **3.14 (eumd) DateTimeStamp primitive**

385 Position of an instant, expressed using xsd:dateTimeStamp, in which the time-zone field is
386 mandatory.

387 **3.15 Duration primitive**

388 Duration as "PnYnMnDTnHnMnS" which conforms to ISO 8601, where nY expresses a number
389 of years, nM a number of months, nD a number of days. The letter T separates the date
390 expression from the time expression and, after it, nH identifies a number of hours, nM a number
391 of minutes and nS a number of seconds. The number of seconds could be expressed as a
392 decimal number, but all other numbers are integers.

393 3.16 Float primitive

394 A floating point number. The range is unspecified and not limited.

395 3.17 (profcim) IRI primitive

396 An IRI (Internationalized Resource Identifier) within an RDF graph is a Unicode string that
397 conforms to the syntax defined in RFC 3987.

398 The primitive is serialized as `rdf:resource` in RDFXML.

399 IRIs in the RDF abstract syntax must be absolute, and may contain a fragment identifier.

400 IRI equality: Two IRIs are equal if and only if they are equivalent under Simple String
401 Comparison according to section 5.1 of [RFC3987]. Further normalization must not be
402 performed when comparing IRIs for equality.

403 IRIs are a generalization of URIs [RFC3986] that permits a wider range of Unicode characters.
404 Every absolute URI and URL is an IRI, but not every IRI is an URI. When IRIs are used in
405 operations that are only defined for URIs, they must first be converted according to the mapping
406 defined in section 3.1 of [RFC3987]. A notable example is retrieval over the HTTP protocol. The
407 mapping involves UTF-8 encoding of non-ASCII characters, %-encoding of octets not allowed
408 in URIs, and Punycode-encoding of domain names.

409 3.18 (profcim) URL primitive

410 A Uniform Resource Locator (URL), colloquially termed a web address, is a reference to a web
411 resource that specifies its location on a computer network and a mechanism for retrieving it. A
412 URL is a specific type of Uniform Resource Identifier (URI), although many people use the two
413 terms interchangeably. URLs occur most commonly to reference web pages (http), but are also
414 used for file transfer (ftp), email (mailto), database access (JDBC), and many other applications.

415 3.19 String primitive

416 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
417 length is unspecified and unlimited.

418 3.20 (profcim) StringFixedLanguage primitive

419 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
420 length is unspecified and unlimited.

421 The primitive is serialized as `literal` without language support.

422 3.21 (profcim) StringIRI primitive

423 An IRI (Internationalized Resource Identifier) within an RDF graph is a Unicode string that
424 conforms to the syntax defined in RFC 3987.

425 The primitive is serialized as `literal` without language support.

426 IRIs in the RDF abstract syntax must be absolute, and may contain a fragment identifier.

427 IRI equality: Two IRIs are equal if and only if they are equivalent under Simple String
428 Comparison according to section 5.1 of [RFC3987]. Further normalization must not be
429 performed when comparing IRIs for equality.

430 IRIs are a generalization of URIs [RFC3986] that permits a wider range of Unicode characters.
431 Every absolute URI and URL is an IRI, but not every IRI is an URI. When IRIs are used in
432 operations that are only defined for URIs, they must first be converted according to the mapping
433 defined in section 3.1 of [RFC3987]. A notable example is retrieval over the HTTP protocol. The
434 mapping involves UTF-8 encoding of non-ASCII characters, %-encoding of octets not allowed
435 in URIs, and Punycode-encoding of domain names.

436

437

438 **Annex A (informative): Sample data**439 **A.1 General**

440 This Annex is designed to illustrate the profile by using fragments of sample data. It is not meant
441 to be a complete set of examples covering all possibilities of using the profile. Defining a
442 complete set of test data is considered a separate activity to be performed for the purpose of
443 setting up interoperability testing and conformity related to this profile.

444 **A.2 Header**

445 <!--Header -->

446 <md:FullModel rdf:about="urn:uuid:d2630bd5-9578-4fab-9647-13991c692d07"><!-- ID of the Full Model in RDF-->

447 <!-- ID of the Full Model in Data Model-->

448 < dct:identifier>urn:uuid:d2630bd5-9578-4fab-9647-13991c692d07</dct:identifier> <!--This is an example for
449 mRID of the header -->

450 <!-- creation time of the Document -->

451 <prov:generatedAtTime>2021-01-28T17:01:03Z</prov:generatedAtTime>

452 <!-- Version of the Document -->

453 <md:version>1</md:version>

454 <!-- Validity/scenario period / delivery day [Optional]-->

455 <time:inXSDDateTimeStamp>2021-11-25T17:00:00Z</time:inXSDDateTimeStamp>

456 <time:hasXSDDuration>P1Y</time:hasXSDDuration>

457 <!-- Description -->

458 <dct:description>This is an example of assessed element</dct:description>

459 <!-- Profile, Schema or Specification -->

460 <dct:conformsTo>http://entsoe.eu/ns/CIM/SecurityAnalysisResult-EU/1.0</dct:conformsTo>

461 <dct:conformsTo> http://entsoe.eu/ns/CIM/SecurityAnalysisResult-EU/constraints/1.0</dct:conformsTo> <!--This
462 is an example how to refer to SHACL constraints -->

463 <!--Generated by -->

464<prov:wasGeneratedBy rdf:resource="urn:entsoe:wgedi:ProcessRunList#DayAheadCGMUpdate"/>

465 <!--Version Info -->

466<owl:versionInfo xml:lang ="en">1.0.0</owl:versionInfo>

467 <!-- Message Type -->

468 <dcat:keyword>PaneModel</dcat:keyword>

469 <!-- Model Dependency-->

470 <prov:wasInfluencedBy rdf:resource="urn:uuid:f0063d01-1dac-46f0-91a4-2b7479991173" />

471 <!--Model revision -->

472 <prov:wasRevisionOf rdf:resource="urn:uuid:8341cd19-779b-4a84-bafb-06b8bb56f767" />

473 <!-- Modeling Authority -->

```

474     <prov:wasAttributedTo rdf:resource="urn:eic:10X1001A1001A094"/>
475     <!-- Modeling Region -->
476     <prov:atLocation rdf:resource="urn:eic:10YBE-----2"/>
477     <!-- Status -->
478     ... <euvoc:status rdf:resource="http://entsoe.eu/StatusType#Validated"/>
479     <!-- License -->
480     ... < dct:license>http://publications.europa.eu/resource/authority/licence/EUPL_1_2</dct:license>
481     <!-- Process Type -->
482     <eumd:processType rdf:resource="urn:entsoe.eu:ProcessTypeList#CSA"/>
483     <!-- Type -->
484     ....<dct:type>dataset</dct:type>
485     <!-- TimeFrame -->
486     <dct:accrualPeriodicity rdf:resource="urn:entsoe.eu:wgedi:TimeFrameList#Y-1"/>
487     <!-- versionInfo -->
488     ....<owl:versionInfo xml:lang ="en">1.0.0</owl:versionInfo>
489     <!--Application Software -->
490     ....<eumd:applicationSoftware>PowerFactory-2021.SP1 </eumd:applicationSoftware>
491     <!--Used settings -->
492     ....<eumd:usedSettings rdf:resource="http://entsoe.eu/loadflowSettings#RelaxedLoadFlow"/>
493     <!-- Modelling Authority of the originator of the model -->
494     <dct:creator>urn:eic:10X1001A1001A094</dct:creator>
495     <!-- Confidentialiaty for Security Plan -->
496     <dct:accessRights rdf:resource="http://entsoe.eu/MVS/2016/Confidentialyt/OPDE_Secret"/>
497     <!--Service Location -->
498     .... <eumd:serviceLocation rdf:resource="urn:eic:10Y1001A1001A94A" />
499     </md:FullModel>
500
501 A.3 Security analysis result
502     <csa:LimitViolation rdf:ID="_94feb1f0-31ee-485e-b07d-60c324cdb9c">
503     <csa:LimitViolation.value>103.5</csa:LimitViolation.value>
504     <csa:LimitViolation.absoluteValue>1200</csa:LimitViolation.absoluteValue>
505     <csa:LimitViolation.dateTime>2021-11-25T17:00:00Z</csa:LimitViolation.dateTime>
506     <csa:LimitViolation.inBaseCase>true</csa:LimitViolation.inBaseCase>
507     <csa:LimitViolation.OperationalLimit rdf:resource="#_fe141a7a-33f9-422a-955b-52958ebf31ad" />

```

```
508     <csa:LimitViolation.ReportedByRegion rdf:resource="#urn:entsoe:10Y1001C--00059P" />
509 </csa:LimitViolation>
510
511 <csa:LimitViolation rdf:ID="_94feb1f0-31ee-485e-b07d-60c324cdbe9c">
512     <csa:LimitViolation.value>103.5</csa:LimitViolation.value>
513     <csa:LimitViolation.absoluteValue>1200</csa:LimitViolation.absoluteValue>
514     <csa:LimitViolation.dateTime>2021-11-25T17:00:00Z</csa:LimitViolation.dateTime>
515     <csa:LimitViolation.inBaseCase>false</csa:LimitViolation.inBaseCase>
516     <csa:LimitViolation.Contingency rdf:resource="#_b2a2dbfa-6eac-4ca6-a31b-6295991bc08b" />
517     <csa:LimitViolation.OperationalLimit rdf:resource="#_fe141a7a-33f9-422a-955b-52958ebf31ad" />
518     <csa:LimitViolation.ReportedByRegion rdf:resource="#urn:entsoe:10Y1001C--00059P" />
519 </csa:LimitViolation>
520
```